



**Arkansas
Department
of Health**

Drinking Water Program

Annual Compliance Report

Public Water System Supervision Program

Calendar Year 2008

Engineering Section
Arkansas Department of Health
4815 West Markham Slot-37
Little Rock, AR 72205-3867

Contact:
David Quattlebaum
Compliance/Enforcement Officer
Telephone (501) 661-2623
Fax (501) 661-2032
david.quattlebaum@arkansas.gov

Table of Contents

INTRODUCTION	3
Arkansas Land Use	3
Characteristics of Arkansas's Water Systems	3
PURPOSE	4
THE STATUTORY ORIGIN	5
ACCESSIBILITY TO PUBLIC	5
SUMMARY OF VIOLATIONS	6
DEVIATION FROM FEDERAL DATABASE	8
VIOLATIONS TABLES: CHEMICAL CONTAMINANTS	10
VIOLATIONS TABLES: TOTAL COLIFORM RULE	11
VIOLATIONS TABLES: SURFACE WATER TREATMENT RULE	11
VIOLATIONS TABLES: LEAD & COPPER RULE	12
VIOLATIONS TABLES: RADIONUCLIDES	11
CONSUMER NOTIFICATION: CONSUMER CONFIDENCE REPORTS & PUBLIC NOTIFICATION	13
DEFINITIONS FOR THE VIOLATIONS TABLES	15
VARIANCES AND EXEMPTIONS	18
ENFORCEMENT DEFINITIONS	19
SUMMARY OF ENFORCEMENT ACTIONS	20
Community Public Water Systems	20
Non-Transient Non-Community Systems	20
Transient Non-Community Systems	20
COMPLIANCE ASSISTANCE EFFORTS	21
Capacity Development Program	21
Sanitary Survey	22
Industry Education	22
Source Water Assessment Plan	23
Microbial / Disinfection Byproduct Rules Programs	23
Area Wide Optimization Program	24
Comprehensive Performance Evaluations	24
Technical Assistance and Training	25
Comprehensive Technical Assistance	26
Laboratory Equipment Check	26
Cross Connection Control Program	26
Water Operator Licensing and Training	27
VIOLATIONS BY TYPE OF SYSTEM GRAPH	28
ENFORCEMENT ACTIONS BY TYPE OF SYSTEM GRAPH	29
APPENDICES	30
APPENDIX A – MICROBIOLOGICAL ACUTE MAXIMUM CONTAMINANT LEVEL VIOLATIONS	31
APPENDIX B – MICROBIOLOGICAL MAXIMUM CONTAMINANT LEVEL VIOLATIONS	32
APPENDIX C – MICROBIOLOGICAL MONITORING – NO VALID SAMPLES	36
APPENDIX D – MICROBIOLOGICAL MONITORING - NO RESAMPLES OF POSITIVE SAMPLES	43
APPENDIX E – SURFACE WATER TREATMENT RULE MONITORING	44
APPENDIX F – SURFACE WATER TREATMENT RULE TREATMENT TECHNIQUE	45
APPENDIX G – CHEMICAL MAXIMUM CONTAMINANT LEVEL VIOLATION	46
APPENDIX H – RADIUM MAXIMUM CONTAMINANT LEVEL VIOLATION	59
APPENDIX I – LEAD & COPPER RULE MONITORING & TREATMENT TECHNIQUE	60
APPENDIX J – NO VIOLATIONS FOR THIS CALENDAR YEAR	61
APPENDIX K – ENFORCEMENT ACTIONS	81

INTRODUCTION

Arkansas Land Use (2008 U. S. Census Bureau Estimate)

Total area of Arkansas	34,036,672 acres
Total area of land	33,328,192 acres
Total area of water	708,480 acres
Total area of forest	15,950,000 acres
Total area of arable land	7,295,000 acres
Total area of wetland	820,619 acres
Total area of barren land	42,000 acres
Total area of developed land	205,340 acres

Characteristics of Arkansas's Water Systems

Population of Arkansas (2008 U. S. Census Bureau Estimate) 2,855,390

Population served by community public water systems	2,633,873
Population served by community surface water systems	1,664,670
Population served by community ground water systems	875,834
Population served by community ground & surface systems	93,369
% population served by public water systems	93.2%
% population served by individual private wells or other source	6.7%

Total number of public water systems active during 2008 1124

Number of community public water systems	711
Number of transient non-community public water systems	367
Number of non-transient non-community public water systems	46
Number of systems inactivated in 2008 and are now Non-public (NP)	
• Community public water systems (NP) System ID (AR0000731)	1
• Transient non-community & Non-transient-non- community (NP)	15
Number of systems using surface water	383
Number of systems using ground water	710
Number of systems using ground & surface	31
Total water used by public water systems (MGD, estimated)	421

PURPOSE

The purpose of this report is to summarize the Arkansas Public Water System violations data submitted to the Safe Drinking Water Information System (SDWIS/FED) for the calendar year 2008. The data include PWS inventory statistics, the incidence of Maximum Contaminant Level, Major Monitoring, and Treatment Technique violations, and the enforcement actions taken against violators. The report provides a total annual representation of the numbers of violations for each of the four categories listed in Section 1414(c)(3) of the Safe Drinking Water Act reauthorization. These four categories include MCLs, treatment techniques, variances and exemptions, and significant monitoring violations.

THE STATUTORY ORIGIN

The EPA established the Public Water System Supervision (PWSS) Program under the authority of the 1974 Safe Drinking Water Act (SDWA). Under the SDWA and its 1986 and 1996 Amendments, EPA sets national limits for contaminant levels in drinking water to ensure that the water is safe for human consumption. These limits are known as Maximum Contaminant Levels (MCLs). For some regulations, EPA establishes treatment techniques in lieu of MCLs to control unacceptable levels of contaminants in water. The EPA also regulates how often public water systems (PWSs) monitor their water for contaminants and requires the monitoring results to be reported to the States or EPA. Generally, the larger the population served by a water system, the more frequent the monitoring and reporting (M/R) requirements. In addition, EPA requires PWSs to monitor for unregulated contaminants to provide data for future regulatory development. Finally, EPA requires PWSs to notify the public when they have violated these regulations. The 1996 Amendments to the SDWA require public notification to include a clear and understandable explanation of the nature of the violation, its potential adverse health effects, steps that the PWS is undertaking to correct the violation and the possibility of alternative water supplies during the violation.

The SDWA applies to the 50 States, the District of Columbia, Indian Lands, Puerto Rico, the Virgin Islands, American Samoa, Guam, the Commonwealth of the Northern Mariana Islands, and the Republic of Palau.

The SDWA allows States and Territories to seek EPA approval to administer their own PWSS Programs. The authority to run a PWSS Program is called primacy. To receive primacy, States must meet certain requirements laid out in the SDWA and the regulations, including the adoption of drinking water regulations that are at least as stringent as the Federal regulations and a demonstration that they can enforce the program requirements. Of the 57 States and Territories, all but Wyoming and the District of Columbia have primacy. The EPA Regional Offices administer the PWSS Programs within these two jurisdictions.

ACCESSIBILITY TO PUBLIC:

The full report will be made available on the Arkansas Department of Health – Engineering Section web site. The address is <http://www.healthyardarkansas.com/eng/viol.htm>.

1. The notice of availability will be published in the Section's quarterly newsletter. This newsletter reaches all Community and Non-transient Non-community PWS's, Consulting Engineers, Government Agencies, and other interested citizens of the state of Arkansas.
2. Copies of the report will be made available at all local health units in Arkansas for public inspection.

Summary of Violations

- No violations occurred during 2008 for the contaminants and rules not shown in the violation tables.
- There were 1124 public water systems in operation during 2008. Seven hundred and eleven (711) were community water systems, forty six (46) were non-transient, non-community water systems, and three hundred and sixty seven (367) were transient non-community water systems.
- A total of three hundred and sixty six (366) major violations occurred for public water systems during 2008. One hundred and four (104) were community water systems, eight (8) were non-transient, non-community water systems, two hundred and five (205) were transient non-community water systems, and forty nine (49) systems were active in CY2008 but are now non-public.
- A total of one hundred and eighty six (186) public water systems had Maximum Contaminant Level violations or Treatment Technique violations. One hundred and fifty five (155) were community water systems, six (6) were non-transient, non-community water systems, and twenty five (25) was a transient non-community water system.
- A total of two hundred and ten (210) public water systems had major monitoring violations. Eighty Six (86) were community water systems, Six (6) were non-transient, non-community water systems, and one hundred and eighteen (118) were transient non-community water systems.
- No variances or exemptions were issued to any public water system in Arkansas during the calendar year 2008.
- 94.1% of the public water systems in Arkansas did not have an organic (SOC, VOC, TTHM, HAA) MCL violation. One system was issued one violation for the (SOC, VOC) analyte groups it was for Trichloroethylene. All other organic violations were for the (TTHM, HAA) analyte groups.
- 100% of the public water systems in Arkansas did not have a nitrate MCL violation.
- 99.7% of the community public water systems in Arkansas did not exceed the radium-226/228 MCL or either of the individual MCL's.
- There were no inorganic chemical violations other than the thirteen violations at four systems whose source contains naturally occurring fluoride.
- There were no monitoring violations for chemicals covered under Phases I, II, IIB, & V. The Arkansas Department of Health performs monitoring of these chemicals on behalf of the public water systems.
- The compliance rate for the contaminants and rules not shown on the violation tables was 100%.

- Using a time and population weighted determination of risk, based on exposure to water that either failed to meet the drinking water standards or which was of unknown quality, Arkansas community water systems achieved the following compliance rates:

	Monitoring	Quality	Overall
Compliance Percentage	99.7%	93.6%	93.3%
Person months exposure	79876	2015649	2095525
Person months possible	31607508	31607508	31607508

In this calculation, a system serving 100 persons that has one violation lasting one month produces a risk of 100 person months. The total risk possible for this system is 1200 person months (100 persons served multiplied by 12 months). In this example, the compliance rate would be $91.6\% = (1200 - 100) / 1200$.

DEVIATION FROM FEDERAL DATABASE

The following discrepancies have been identified between the Federal database on which the national Annual Compliance Report will be based (Frozen) and the Arkansas state drinking water program database, SDWIS/STATE (State).

Disinfection Byproducts Rule (DBP): (Violation Code 2)

Database	# SYSTEMS	# VIOLATIONS
State: Total	55	163
Frozen:	56	165

Reason: One system had two violations rescinded (PWS ID# AR0000737) in January 2009 and is not reflected in the frozen data.

Total Coliform Rule: (Violation Code 22)

Database	# SYSTEMS	# VIOLATIONS
State: Total	109	92
Frozen:	106	89

Reason: There are two systems AR0000039 and AR0000191 who had 2008 violations but data entry was in April of 2009 and not reflected in the frozen data. One system ARN000020 was inactivated in 2008 and is now a Non-Public system and not reflected in EPA's frozen data.

Total Coliform Rule: (Violation Code 23)

Database	# SYSTEMS	# VIOLATIONS
State: Total	166	239
Frozen:	159	226

Reason: There are seven systems which went to a non-public status in 2008 that are not reflected in the frozen federal database, which account for 7 systems and 13 violations.

Disinfection Byproducts Rule (DBP): (Violation Code 27)

Database	# SYSTEMS	# VIOLATIONS
State: Total	4	4
Frozen:	6	6

Reason: There were 2 systems with one violation each whose violations were rescinded after the Federal reporting cycle May 15, 2008. System identification numbers are AR0000122 and AR0000123.

Disinfection Byproducts Rule (DBP): (Violation Code 36)

Database	# SYSTEMS	# VIOLATIONS
State: Total	10	15
Frozen:	11	16

Reason: There was 1 system with one violation (ART000045) whose violation was rescinded in 2008 and not reflected in EPA's frozen data.

Disinfection Byproducts Rule (DBP: (Violation Code 38)

Database	# SYSTEMS	# VIOLATIONS
State: Total	3	5
Frozen:	4	6

Reason: There was 1 system with one violation (ART000852) whose violation was rescinded in 2008 and not reflected in EPA's frozen data.

Treatment Technique (SWTR/IESSWTR): (Violation Code 41)

Database	# SYSTEMS	# VIOLATIONS
State: Total	4	5
Frozen:	5	7

Reason: One system (PWSID# AR0000670) with two violations which were rescinded in calendar year 2008 but are still reflected in EPA's frozen data.

Treatment Technique (SWTR/IESSWTR): (Violation Code 42)

Database	# SYSTEMS	# VIOLATIONS
State: Total	4	10
Frozen:	4	33

Reason: One system PWSID# AR0000616 had 23 violations in 2007 that are reflected in the 2008 data because of a second SOX date of 01/28/2008 creating a incorrect violation end date.

Failure to filter (SWTR): (Violation Code 43)

Database	# SYSTEMS	# VIOLATIONS
State: Total	8	12
Frozen:	4	8

Reason: There are four systems AR0000088, AR0000237, AR0000413, AR0000821 with one violation each issued in 2008 not reported to SDWIS/FED due to a determination date of 04/01/2009. This puts the violations in the wrong calendar year.

Failure to filter (SWTR): (Violation Code 44)

Database	# SYSTEMS	# VIOLATIONS
State: Total	6	15
Frozen:	5	14

Reason: One system PWSID# AR0000422 which had one violation in 2008 but data entry did not occur until 04/01/2009 creating an incorrect determination date.

Failure to filter (SWTR): (Violation Code 46)

Database	# SYSTEMS	# VIOLATIONS
State: Total	3	8
Frozen:	5	10

Reason: Two systems PWSID# AR0000109 and AR0000326 each with one violation were rescinded in 2008 are still reflected in the EPA frozen data.

VIOLATIONS TABLES: CHEMICAL CONTAMINANTS

	SDWIS Codes	MCL (mg/l)	MCLs		Treatment Techniques		Significant Monitoring/Reporting	
			Number of violations T/C/N/P	Number of Systems with Violations T/C/N/P	Number of Violations	Number of Systems with Violations	Number of Violations T/C/N/P	Number of Systems With Violations T/C/N/P
Inorganic Contaminants								
Fluoride	1025	4.0	11/11/0/0	2/2/0/0			0	0
Organic Contaminants								
Trichloroethylene	2984	0.005	1/1/0/0	1/1/0/0			0	0
Subtotal			12/12/0/0	3/3/0/0			0	0

	SDWIS Codes	MCL (mg/l)	MCLs		Treatment Techniques		Significant Monitoring/Reporting	
			Number of violations T/C/N/P	Number of Systems with Violations T/C/N/P	Number of Violations T/C/N/P	Number of Systems with Violations T/C/N/P	Number of Violations T/C/N/P	Number of Systems With Violations T/C/N/P
Disinfectants / Disinfection ByProducts								
Stage 1 DBPR	0400				1/0/1/0	1/0/1/0		
Stage 1 DBPR	0999						22/17/0/0	17/17/0/0
Chlorite	1009						0/0/0/0	0/0/0/0
Total Haloacetic Acids (HAA5)	2456	0.060	29/29/0/0	18/18/0/0				
Total Organic Carbon	2920				0/0/0/0	0/0/0/0		
Total Trhhalomethanes (TTHM)	2950	0.08	134/127/0/7	51/48/0/3				
Subtotal			163/156/0/7	69/66/0/3	1/0/1/0	1/0/1/0	22/17/0/0	17/17/0/0

T/C/N/P – Total /Community PWS / Transient Non-Community PWS / Non-Transient Non-Community PWS

VIOLATIONS TABLES: TOTAL COLIFORM RULE

	SDWIS Codes	MCL (mg/l)	MCLs		Treatment Techniques		Significant Monitoring/Reporting	
			Number of violations T/C/N/P	Number of Systems with Violations T/C/N/P	Number of Violations	Number of Systems with Violations	Number of Violations T/C/N/P	Number of Systems With Violations T/C/N/P
Total Coliform Rule								
Acute MCL violation	21	Presence	0/0/0/0	0/0/0/0				
Non-Acute MCL violation	22	Presence	109/84/22/3	92/71/18/3				
Major routine monitoring	23						239/57/176/6	166/51/110/5
Major follow up monitoring	25						36/11/25/0	26/8/18/0
Sanitary survey	28						0/0/0/0	0/0/0/0
Subtotal			109/84/22/3	92/71/18/3			275/68/201/6	192/59/128/5

VIOLATIONS TABLES: SURFACE WATER TREATMENT RULE

	SDWIS Codes	MCL (mg/l)	MCLs		Treatment Techniques		Significant Monitoring/Reporting	
			Number of violations	Number of Systems with Violations	Number of Violations T/C/N/P	Number of Systems with Violations T/C/N/P	Number of Violations T/C/N/P	Number of Systems With Violations T/C/N/P
Surface Water Treatment Rule								
<u>Filtered Systems</u>								
Monitoring, routine/repeat	36						15/13/2/0	10/8/2/0
Monitoring, routine/filter turbidity	38						5/4/1/0	3/2/1/0
Treatment techniques	41				5/4/1/0	4/3/0/1		
Failure to filter	42				10/1/2/7	4/1/1/2		
Treatment Tech > Turb 1 NTU	43				12/10/2/0	8/7/1/0		
Treatment Tech > Turb 3 NTU	44				15/13/2/0	6/5/1/0		
Subtotal					40/26/7/7	21/15/3/3	20/17/3/0	13/10/3/0

VIOLATIONS TABLES: LEAD & COPPER RULE

	SDWIS Codes	MCL (mg/l)	MCLs		Treatment Techniques		Significant Monitoring/Reporting	
			Number of violations T/C/N/P	Number of Systems with Violations T/C/N/P	Number of Violations T/C/N/P	Number of Systems with Violations T/C/N/P	Number of Violations T/C/N/P	Number of Systems With Violations T/C/N/P
Lead and Copper Rule								
Initial lead and copper tap M/R	51						3/3/0/0	3/3/0/0
Follow-up or routine lead and copper tap M/R	52						50/48/0/2	36/34/0/2
Treatment Installation	58				1/1/0/0	1/1/0/0		
Public education	65				17/15/0/2	12/10/0/2		
Subtotal					18/16/0/2	13/11/0/2	53/51/0/2	39/37/0/2

T/C/N/P – Total /Community PWS / Transient Non-Community PWS / Non-Transient Non-Community PWS

VIOLATIONS TABLES: RADIONUCLIDES

	SDWIS Codes	MCL (mg/l)	MCLs		Treatment Techniques		Significant Monitoring/Reporting	
			Number of violations T/C/N/P	Number of Systems with Violations T/C/N/P	Number of Violations	Number of Systems with Violations	Number of Violations T/C/N/P	Number of Systems With Violations T/C/N/P
Radionuclide MCLs								
Gross alpha	4000	15 Pci/l	0/0/0/0	0/0/0/0			0	0
Radium-226 and Radium-228	4010	5 pCi/l	12/12/0/0	3/3/0/0			0	0
Gross beta	4101	4 mrem/yr	0	0			0	0
Subtotal			12/12/0/0	3/3/0/0			0	0

T/C/N/P – Total /Community PWS / Transient Non-Community PWS / Non-Transient Non-Community PWS

CONSUMER NOTIFICATION: CONSUMER CONFIDENCE REPORTS & PUBLIC NOTIFICATION

	SDWIS Codes	MCL (mg/l)	MCLs		Treatment Techniques		Significant Monitoring/Reporting	
			Number of violations T/C/N/P	Number of Systems with Violations T/C/N/P	Number of Violations	Number of Systems with Violations	Number of Violations T/C/N/P	Number of Systems With Violations T/C/N/P
Consumer Confidence Report	71						51/51/0/0	51/51/0/0
Public Notification	75						0*	0*
Subtotal							51/51/0/0	51/51/0/0

T/C/N/P – Total /Community PWS / Transient Non-Community PWS / Non-Transient Non-Community PWS

* The Department of Health did not issue Public Notification (PN) violations during 2008.

DEFINITIONS FOR THE VIOLATIONS TABLES

Public Water System: A Public Water System (PWS) is defined as a system that provides water via piping or other constructed conveyances for human consumption to at least 15 service connections or serves an average of at least 25 people for at least 60 days each year. There are three types of PWSs. PWSs can be community (such as towns), nontransient non-community (such as schools or factories), or transient non-community systems (such as rest stops or parks). For this report when the acronym “PWS” is used, it means systems of all types unless otherwise specified.

Filtered Systems: Water systems that have installed filtration treatment [40 CFR 141, Subpart H].

Inorganic Contaminants: Non-carbon-based compounds such as metals, nitrates, and asbestos. These contaminants are naturally-occurring in some water, but can get into water through farming, chemical manufacturing, and other human activities. EPA has established MCLs for 15 inorganic contaminants [40 CFR 141.62].

Lead and Copper Rule: This rule established national limits on lead and copper in drinking water [40 CFR 141.80-91]. Lead and copper corrosion pose various health risks when ingested at certain levels, and can enter drinking water from household pipes and plumbing fixtures. States report violations of the Lead and Copper Rule in the following six categories:

Initial lead and copper tap M/R: SDWIS Violations Code 51 indicates that a system did not meet initial lead and copper testing requirements, or failed to report the results of those tests to the State.

Follow-up or routine lead and copper tap M/R: SDWIS Violations code 52 indicates that a system did not meet follow-up or routine lead and copper tap testing requirements, or failed to report the results.

Treatment installation: SDWIS Violation Code 58 indicates a failure to install optimal corrosion control treatment system or source water treatment system which would reduce lead and copper levels in water at the tap.

Public Education: SDWIS Violation Code 65 shows that a system did not provide required public education about reducing or avoiding lead intake from water.

Maximum Contaminant Level (MCL): The highest amount of a contaminant that EPA allows in drinking water. MCLs ensure that drinking water does not pose either a short-term or long-term health risk. MCLs are defined in milligrams per liter (parts per million) unless otherwise specified.

Monitoring: EPA specifies which water testing methods the water systems must use, and sets schedules for the frequency of testing. A water system that does not follow EPA’s schedule or methodology is in violation [40 CFR 141].

States must report monitoring violations that are significant as determined by the EPA Administrator and in consultation with the States. For purposes of this report, significant monitoring violations are major violations and they occur when no samples are taken or no results are reported during a compliance period.

A major monitoring violation for the surface water treatment rule occurs when at least 10% of the required samples are not taken or results are not reported during the compliance period.

Organic Contaminants: Carbon-based compounds, such as industrial solvents and pesticides. These contaminants generally get into water through runoff from cropland or discharge from factories. EPA has set legal limits on 54 organic contaminants that are to be reported [40 CFR 141.61].

Radionuclides: Radioactive particles, which can occur naturally in water or result from human activity. EPA has set legal limits on five types of radionuclides: radium-226, radium 228, gross alpha, and beta particle/photon radioactivity, and uranium [40 CFR 141]. Violations for these contaminants are to be reported using the following three categories:

Gross alpha: SDWIS Contaminant Code 4000 for alpha radiation above MCL of 15 picocuries/liter. Gross alpha includes radium-226 but excludes radon and uranium.

Combined radium-226 and radium-228: SDWIS Contaminant Code 4010 for combined radiation from these two isotopes above MCL of 5 pCi/L.

Gross beta: SDWIS Contaminant Code 4101 for the combination of beta particles and photon radioactivity resulting from man-made radionuclides above 4 millirem/year.

Uranium: SDWIS Contaminant Code 4006 for combined uranium above the MCL of 30 micrograms/liter.

Reporting Interval: The reporting interval for violations reported in the 2008 PWS Annual Compliance Report is January 1, 2008 through December 31, 2008.

SDWIS Code: Specific numeric codes from the Safe Drinking Water Information System (SDWIS) have been assigned to each violation type included in this report. The violations to be reported include exceeding contaminant MCLs, failure to comply with treatment requirements, and failure to meet monitoring and reporting requirements. Four-digit SDWIS Contaminant Codes have also been included in the chart for specific MCL contaminants.

Surface Water Treatment Rule: The Surface Water Treatment Rule establishes criteria under which water systems supplied by surface water sources, or ground water sources under the direct influence of surface water, must filter and disinfect their water [40 CFR 141, Subpart H]. Violations of the “Surface Water Treatment Rule” are to be reported for the following four categories:

Monitoring, routine/repeat (for filtered systems): SDWIS Violation Code 36 indicates a system's failure to carry out required tests, or to report the results of those tests.

Treatment techniques (for filtered systems): SDWIS Violations 41, 43, and 44 show a system's failure to properly treat its water.

Treatment techniques (for unfiltered systems): SDWIS Violations 41, 43, and 44 show a system's failure to properly treat its water.

Monitoring, routine/repeat (for unfiltered systems): SDWIS Violation Code 31 indicates a system's failure to carry out required water tests, or to report the results of those tests.

Failure to filter (for unfiltered systems): SDWIS Violation Code 42 shows a system's failure to properly treat its water.

Total Coliform Rule (TCR): The Total Coliform Rule establishes regulations for microbiological contaminants in drinking water. These contaminants can cause short-term health problems. If no samples are collected during the one-month compliance period, a significant monitoring violation occurs. States are to report four categories of violations:

Acute MCL violation: SDWIS Violation Code 21 indicates that the system found fecal coliform or E. coli, potentially harmful bacteria, in its water, thereby violating the rule.

Non-acute MCL violation: SDWIS Violation code 22 indicates that the system found total coliform in samples of its water at a frequency or at a level that violates the rule. For systems collecting fewer than 40 samples per month, more than one positive sample for total coliform is a violation. For systems collecting 40 or more samples per month, more than 5% of the samples positive for total coliform is a violation.

Major routine and follow-up monitoring: SDWIS Violation Codes 23 AND 25 show that a system did not perform any monitoring. [One number is to be reported for the sum of violations in these two categories.]

Sanitary Survey: SDWIS Violation Code 28 indicates a major monitoring violation if a system fails to collect 5 routine monthly samples if a sanitary survey is not performed.

Treatment Techniques: A water treatment process that EPA requires instead of an MCL for contaminants that laboratories cannot adequately measure. Failure to meet other operational and system requirements under the Surface Water Treatment and the Lead and Copper Rules have also been included in this category of violation for purposes of this report.

Unfiltered Systems: Water systems that do not need to filter their water before disinfecting it because the source is very clean [40 CFR, Subpart H].

Violation: A failure to meet any state or federal drinking water regulation.

VARIANCES AND EXEMPTIONS

Variations and exemptions to specific requirements under the Safe Drinking Water Act Amendments of 1996 may be granted under certain circumstances. If, due to the characteristics of the raw water sources reasonably available, a PWS cannot meet the MCL, a primacy State can grant the PWS a variance from the applicable primary drinking water regulation on the condition that the system install the best available technology, treatment techniques, or other means which the Administrator finds are available (taking costs into account). The state must find that the variance will not result in an unreasonable risk to health, and shall prescribe, at the time the variance is granted, a schedule (including increments of progress) in accordance with which the PWS must come into compliance with the MCL. Small systems (serving 3,300 or fewer persons; or 10,000 or fewer persons with the Administrator's approval) may be granted variances if they cannot afford (as determined by application of the Administrator's affordability criteria) to comply with certain MCLs (non-microbial, promulgated after January 1, 1986) by means of treatment, alternative source of water, or restructuring or consolidation. Small systems must, within 3 years, install and operate EPA approved small system variance technology. The variance must ensure adequate protection of human health, and the variance shall be reviewed not less than every 5 years to determine whether the system remains eligible for the variance. A primacy State may by exemption relieve a PWS of its obligation to comply with an MCL, treatment technique, or both if the system's noncompliance results from compelling factors (which may include economic factors, the system was in operation on the effective date of the MCL or treatment technique requirement) or if not in operation by that date, only if no reasonable alternative source of drinking water is available to such new systems, management or restructuring changes cannot reasonably be made that will result in compliance with the SDWA or improvement of water quality, and the exemption will not result in an unreasonable risk to public health. The State will require the PWS to comply with the MCL or treatment technique as expeditiously as practicable, but not later than 3 years after the otherwise applicable compliance date. No variances or exemptions were issued to any public water system in Arkansas during the calendar year 2008.

ENFORCEMENT DEFINITIONS

The Arkansas Department of Health has developed a multi stage enforcement escalation scheme which pair's technical assistance with multiple opportunities to return to compliance. The ADH utilizes methods such as sanitary surveys and operator assistance to prevent water quality problems from occurring. Enforcement is with the attitude of protecting the public health with any and all tools available to achieve compliance.

Phase 1: A very informal means of enforcement. With every Safe Drinking Water Act (SDWA) violation, a Notice of violation is issued explaining what the system failed to do, in anticipation of correcting the problem. If necessary, a site visit may be required to assist the water system into achieving compliance.

Phase 2: When an Acute violation or several other violations occur and meet our escalation policy we issue a **Warning of Administrative Order** (WAO). This is our 1st formal enforcement action & last chance for voluntary compliance. This letter formally warns the operator that if an additional violation occurs an Administrative Order will be issued to correct the deficiencies.

Phase 3: If the system has an additional violation within the 12 months following the WAO, an **Administrative Order** (AO) is issued, requiring the system to correct all deficiencies and comply fully with the SDWA.

Phase 4: If the AO is not complied with a **Proposed Penalty** (PP) is calculated based on the population, severity, correct ability and frequency of the violations. It is then issued to the system and a hearing date is scheduled for a Subcommittee of the Arkansas State Board of Health.

Phase 5: Once the proposed penalty is issued the water system operator can either go to the hearing before the subcommittee of the Board of Health or enter into a Consent Order settling the penalty [**Penalty Suspended** (PS) or **Penalty Assessed** (PA)].

SUMMARY OF ENFORCEMENT ACTIONS

Following is a summary of the enforcement actions taken in 2008.

Community Public Water Systems

State Formal Notification of Violation (SFJ).....	51
Administrative Orders Issued (SFL).....	14
Proposed Penalties Issued (SFN).....	2
Penalties Suspended – Board of Health (SFO).....	0
Penalties Assessed – Bilateral Compliance Agreements (SFK).....	0
Penalties Assessed – Board of Health (SFM).....	0
Total Enforcement Actions for CWSs.....	67

Non-Transient Non-Community Systems

State Formal Notification of Violation (SFJ).....	1
Administrative Orders Issued (SFL).....	0
Proposed Penalties Issued (SFN).....	0
Penalties Suspended – Board of Health (SFO).....	0
Penalties Assessed – Bilateral Compliance Agreements (SFK).....	0
Penalties Assessed – Board of Health (SFM).....	0
Total Enforcement Actions for NTNCs.....	1

Transient Non-Community Systems

State Formal Notification of Violation (SFJ).....	13
Administrative Orders Issued (SFL)	8
Proposed Penalties Issued (SFN).....	2
Penalties Suspended – Board of Health (SFO).....	0
Penalties Assessed – Bilateral Compliance Agreements (SFK).....	0
Penalties Assessed – Board of Health (SFM).....	0
Total Enforcement Actions for TNCs.....	23

COMPLIANCE ASSISTANCE EFFORTS

Capacity Development Program

Under the Capacity Development Program, the Engineering Section has established two contracts with third party technical assistance providers for small systems (<10,000 population) technical assistance. The main purpose of the contracts is to help small public water systems develop the ability to achieve and maintain compliance with applicable national primary and secondary drinking water regulations. Helping the water system attain a state of self-sufficiency is the primary goal.

The existing contracts expired before July 1, 2009. These contracts were rebid through a request for proposal process late 2008 and early in 2009. Community Resource Group, Inc. was the low bidder for both contracts. They will be doing both the Financial and Managerial Contract as well as the Technical and Operational Contract.

Contractors go on-site to the water systems and conduct assessments addressing various technical, financial, and managerial aspects of the systems. Next a strategy is developed by the contractor with the water system to address areas where the system has deficiencies in their capacity. On-site and telephone verifications are later conducted by the contractors to monitor how well the systems are implementing the strategy. For the calendar year 2008, as part of the Technical and Operational Contract, CRG conducted eighteen (18) assessments, developed eighteen (18) strategies, provided 314 on-site technical assistance hours of training, participated in one (1) CPE. For the calendar year 2008, as part of the Financial and Managerial Contract, CRG conducted nine (9) assessments, nine (9) strategies, provided 1104 technical assistance hours of training and participated in 2 CPEs.

As part of the Sections' initiatives to promote and improve the asset sustainability of small public water systems, the Section contracted with Magnolia River Services, Inc [MRS] to assist high priority small public water systems to assess and improve their infrastructure by physically locating and mapping the primary water system assets with GPS equipment and then importing the field collected data onto the utilities computer. MRS then installed a GIS platform onto the utilities computer and trained the staff on the use of the software and how to view and print maps. For SFY 2009, MRS completed 13 assessment reports, collected GPS data at 13 water systems, and installed and trained 13 water systems on the use of the GIS software.

Sanitary Surveys

Sanitary Surveys conducted by technical staff can consist of reporting deficiencies in the construction or design of a public water system or the operation of the public water system. Sanitary Surveys combined with monitoring and reporting, to complement each other, can be indispensable for assuring the long-term quality and safety of drinking water. In calendar year 2008, there were approximately three hundred and forty five (345) sanitary surveys performed. Two hundred and twenty one (221) Sanitary Surveys were performed on the state's community water systems, one hundred and eight (108) Sanitary Surveys were performed on transient non-community water systems and sixteen (16) on non-transient non-community water systems and six (6) on systems that went to a non-public status in calendar year 2007. During the sanitary surveys of community and non-transient non-community water systems, owners are notified of "significant deficiencies". A list of significant deficiencies was developed by ADH staff in compliance with the sanitary survey requirements of the Interim Enhanced Surface Water Treatment Rule and in preparation for the proposed Ground Water Rule. Significant deficiencies are obvious shortcomings that could directly affect water quality and require immediate attention by the owner. Under ADH protocol developed, owners are notified verbally of the deficiency during the survey and again notified by letter following the survey. The water system is given 45 days following the written notification to respond with a plan of action and a timetable to address the significant deficiency.

Industry Education

The Engineering Section has continued its efforts in educating members of the water industry as well as the general public with its web site and its quarterly newsletter. From the website, water operators can obtain information about various Section programs; download copies of state regulations, policies, compliance documents and operations reports; determine the result of microbiological analyses, and obtain information or guidance about numerous other areas of the drinking water program

The Section's quarterly newsletter, *Arkansas Drinking Water Update*, has a distribution of over 3800, and a copy is mailed to every water system or licensed water operator as well as all city mayors within the state. Every issue of the newsletter contains information of relevance to the water industry including articles on proposed and final state and federal regulations as well as guidance for implementing the regulations, capacity development, source water protection, water system security, cross connection control, operator training, water licensing, water treatment, area wide optimization, noncompliant systems, fluoridation, and others.

Source Water Assessment Plan

The Source Water Assessment program, required by the Safe Drinking Water Act Amendments of 1996, was developed by the Department of Health, and submitted to and approved by the Environmental Protection Agency during calendar year 1999. SWAP reports were produced for each Public Water System to serve as a management tool for implementing source protection activities. Initially, the Source Water Assessment Program accurately located all sources of drinking water utilized by public water systems, delineated source water “assessment areas” around each source, and mapped potential contaminants within the delineated areas for approximately one thousand five hundred (1500) drinking water sources in Arkansas in 2003.

Since 2003 the collection of data needed for updating the source water assessments has been ongoing. In CY2008 it was determined that a review of the source water assessment methodology be initiated in an effort to evaluate whether or not a more accurate source water vulnerability assessments can be made. At this time it is anticipated that a review of the source water assessment methodology will be conducted during CY2009 prior to updating the source water assessments.

During CY2008 a total of fourteen (14) Phase I “Delineation” Wellhead Protection (WHP) reports covering sixteen (16) wells and nineteen (19) Phase II “PSOC Inventories” WHP reports covering fifty-five (55) wells were completed. The Arkansas Rural Water Association (ARWA) source protection staff completed two (2) source water protection plans covering three (3) separate surface water sources. This data will be incorporated into the source water assessment program databases for use in the next source water assessment. In addition program staff continued to maintain existing SWAP GIS databases, provided seven (7) presentations and informational booths regarding source water protection, disseminated eight (8) SWAP reports to public water suppliers, completed forty-one (41) PWS well recommendations, and processed 1,821 miscellaneous permit reviews. Additional activities include screening and responding to requestors for SWAP GIS data, performing proximity analysis, and reviewing and commenting on various construction and environmental related projects that have the potential to impact public water supply sources in the state. During CY2008 a total of thirty-six (36) of these request and reviews were processed by program staff.

Microbial / Disinfection Byproduct Rules Programs

The Arkansas Department of Health has been providing early implementation activities for the LT2ESWTR, Stage 2 DBPR and GWR. Compliance assistance efforts for the calendar year 2008 in these areas include:

LT2ESWTR: As part of early implementation strategies for large systems, source monitoring for *cryptosporidium*, *E. coli*, and turbidity continued monthly throughout the year for 23 large system sources. Analysis of samples was outsourced to Biovir Laboratories for large systems and the results were uploaded to the DCTS for system, state, and EPA review. Grading for monitoring and reporting requirements was conducted on a monthly basis for each of these large system sources. There were no violations issued for repeated failure to conduct source monitoring for *cryptosporidium*

for large systems. A total of 23 sources were monitored within 21 systems classified as large. Source water for fourteen (14) or 61% systems was from a lake or reservoir and nine (9) or 39% systems were from flowing streams. Source water monitoring data will be used to categorize the source water *Cryptosporidium* concentration into one of four “bin” classifications based on the average concentration of the pathogen in the source water. The majority of the systems nineteen (19) or 83% will remain classified in the lowest treatment bin (Bin 1). A total of eight (9) or 39% of the systems tested positive for *Cryptosporidium* in their source water. However, four (4) or 17%, of the systems will be reclassified into Bin 2, which will require an

Area Wide Optimization Program

The Arkansas Department of Health has been participating in the EPA Region 6 Area Wide Optimization Program (AWOP) with the States of Oklahoma, Louisiana, and New Mexico, EPA Region 6 staff, EPA Technical Support Center Staff, and staff from Process Applications, Inc., an EPA contractor. During Calendar year 2008, staff members attended the AWOP quarterly meetings and shared information and program implementation with other states. Turbidity data from monthly operation reports was entered into an Access database for performance tracking and to determine prioritization of efforts. As discussed below, staff also conducted 4 Comprehensive Performance Evaluations and provided plant specific technical assistance.

Comprehensive Performance Evaluations

A total of four (4) CPE's were conducted during calendar year 2008. A Comprehensive Performance Evaluation (CPE) is an evaluation of a surface water plant to determine whether the drinking water facility is operating at its optimum capacity and is maintaining compliance with applicable drinking water regulations. The CPE is a systematic procedure that identifies the unique combination of factors, in the areas of design, operation, maintenance and administration that would limit the performance of the surface water plant. It was developed to improve performance by using existing facilities thereby minimizing construction alternatives. The CPE is focused on improving performance of surface water treatment plants by optimizing the use of existing facilities, and, if possible, avoiding construction of new facilities. The ADH has established a goal of conducting four (4) to six (6) CPE's per calendar year. In calendar year 2008, CPE's were conducted at the Montgomery County Regional, Benton, Conway County Regional, and Mena water treatment plants.

Technical Assistance & Training

Technical assistance and training provided by the Engineering staff occurs in many different areas and in many different forms. Among the more common areas in which technical assistance and training were provided are the following:

- Comprehensive Performance Evaluations and follow-ups.
- Comprehensive Technical Assistance
- Jar tests and jar test calibrations
- Disinfection profiles
- Chlorine control studies
- Filter studies & filter backwash procedure studies
 - Process control sampling and evaluations
 - Field testing of total trihalomethanes
 - Bench scale testing of treatment plant modifications
 - Distribution system evaluations and modeling to lessen water age and improve water quality.
 - Storage tank evaluations and modeling to lessen water age and improve water quality.
 - Tracer studies
 - Collection of special samples for inorganic and organic analyses
 - Evaluation, testing and recommendations on treatment modifications to improve water quality in areas such as disinfection by-products reduction, coagulants, filters, filter backwash, total organic carbon removal, color removal, disinfectants, oxidants, and iron and manganese removal.
 - Evaluation, testing, and recommendations on the employment of alternate water sources due to drought conditions.
 - Evaluation, testing, and recommendations on the development of new sources of water.
 - Training of water operators in basic system operation, and onsite water quality monitoring including turbidity, pH, chlorine and, chlorine dioxide.
 - Input and recommendations on long range and master planning
 - Cross connection control program implementation, surveys, and incident investigation.

Among the water systems receiving technical assistance were: Alma, Booneville, Faircrest, Community, Mayflower, Fountain Hill, Crossett, Nashville, Nashville Rural, El Dorado, Mount Ida, Montgomery County, Portland, Montrose, Sevier County WA, North Garland Co. WA, New London, S.E. Bradley Co., Waldron, Little River WA, Pike City, Atkins, and Prescott.

Comprehensive Technical Assistance

Arkansas has been involved in a Comprehensive Training Project with the Alma water system and with EPA's Technical Support Center for 5 years now. During 2008, the focus was on the distribution system and storage tanks. Fluctuations and variations in DBP and chlorine levels are being evaluated. A second storage tank has been found to have zero or near zero chlorine residuals and different tank operation strategies are being evaluated in order to improve water quality. Alma has installed a tank mixer in one of the storage tanks. The tank is now well mixed but continues to have zero or near zero chlorine residuals.

Laboratory Equipment Check

For the summers of past years, the Engineering Section has employed a summer intern to check calibration of monitoring equipment, specifically turbidity and chlorine, at systems throughout the state. However, due to resource constraints, the Section did not have such a program in 2008. Turbidity checks at surface water treatment plants and chlorine checks at other plants are still routinely conducted as part of the sanitary survey.

CROSS-CONNECTION CONTROL PROGRAM

Approximately 76% of the community water systems surveyed report that they have a CCCP established. Approximately 49% of the systems report that their programs are 100 % complete. This means that they have inspected their existing commercial and industrial customers' establishments to determine if backflow hardware is required, they have had the units installed where needed, the units are being tested annually, and the system is keeping accurate records and overseeing continued compliance. Each year some systems let their cross-connection control program lapse because of operator turnover or from general lack of effort.

The cross-connection control engineer of the ADH made fifty-nine (59) cross-connection program surveys at water utilities, not including follow-up visits. Of these utilities, ten systems had no program. During the year, several systems have implemented or improved their cross-connection control programs including United Water, Rogers, Fort Smith, Marion, Fordyce, Highfill, and Mountainburg. Eight (8) visits were made to waterworks district meetings and conferences to provide CCCP presentations and training. Information was updated on the Engineering website to assist water utilities and individuals meet backflow testing requirements. The cross-connection control engineer is active in the American Backflow Prevention Association and the Backflow Prevention Association of Arkansas of which he/she is a member of the board of directors


Water Operator Licensing and Training

The purpose of licensing and training water operators is to ensure that all public water systems in the State of Arkansas are maintained by personnel who have shown their competence and knowledge of the public health and scientific principles necessary to produce and deliver adequate quantities of water which meets or exceeds the National Primary and Secondary Drinking Water Standards.


In order to sit for water operator license exams specific curriculum based courses must be attended. The courses range from 8 to 24 hours in length with a total of 40 hours required for the lowest license grades and 96 hours for the highest license grades. The approved course providers for the Treatment, Distribution and Math courses are the Arkansas Environmental Academy (They provided 66 courses in 2008, 26 were OpCert Grant funded and 24 were provided utilizing the internet.) and the Arkansas Rural Water Association (They provided 43, courses in 2008, 27 were Op-Cert Grant funded). The Engineering Section is the only approved provider of the required PWS Regulation and SDWA Compliance course (provided the course 17 times in 2008). A total of 126 mandatory training sessions were offered by the three approved training organizations in calendar year 2008. In addition to the above courses, approved general and specialized training is provided at: the annual conference and monthly meetings of the Arkansas Water Works and Water Environment Association and its nine (9) regional districts; the annual conference and specialty workshops of the Arkansas Rural Water Association; specialty workshops of the Arkansas Environmental Academy; and a large array of other relevant training is offered to water operators by various other industry groups and private vendors. Most of this training is approved for license renewal credit to assist licensed operator in meeting their continuing education requirement.

In calendar year 2008, approximately 351 water operator license exams were administered, 220 water operator licenses were issued, and 106 Operator-In-Training (OIT) certificates were issued. An OIT is issued to operators who do not meet the experience requirement at the time their license exam was passed. Upon completion of their experience requirement the license is issued. The water licensing program had 2,225 active licensed water operators at the end of calendar year 2008. They held 3,358 treatment, distribution, and/or very small system licenses.

Violations By Type Of System Graph

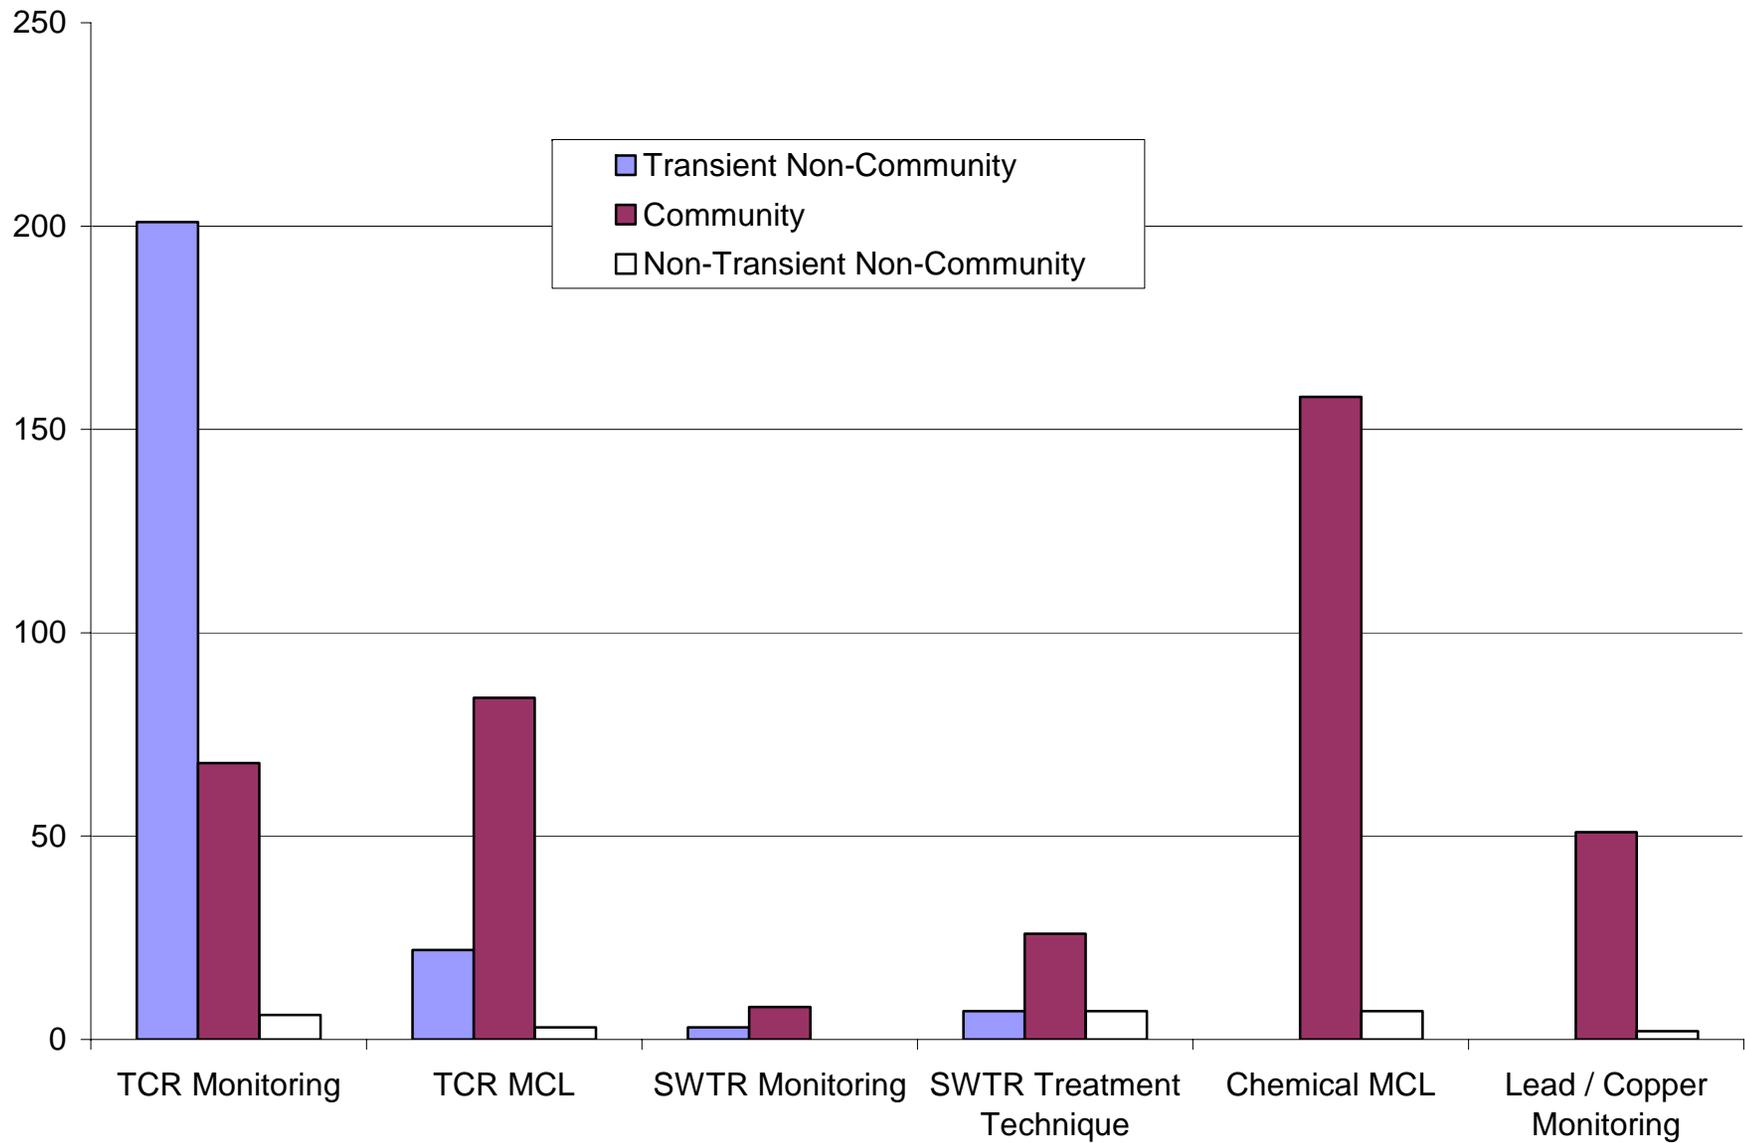

Enforcement Actions By Type Of System Graph

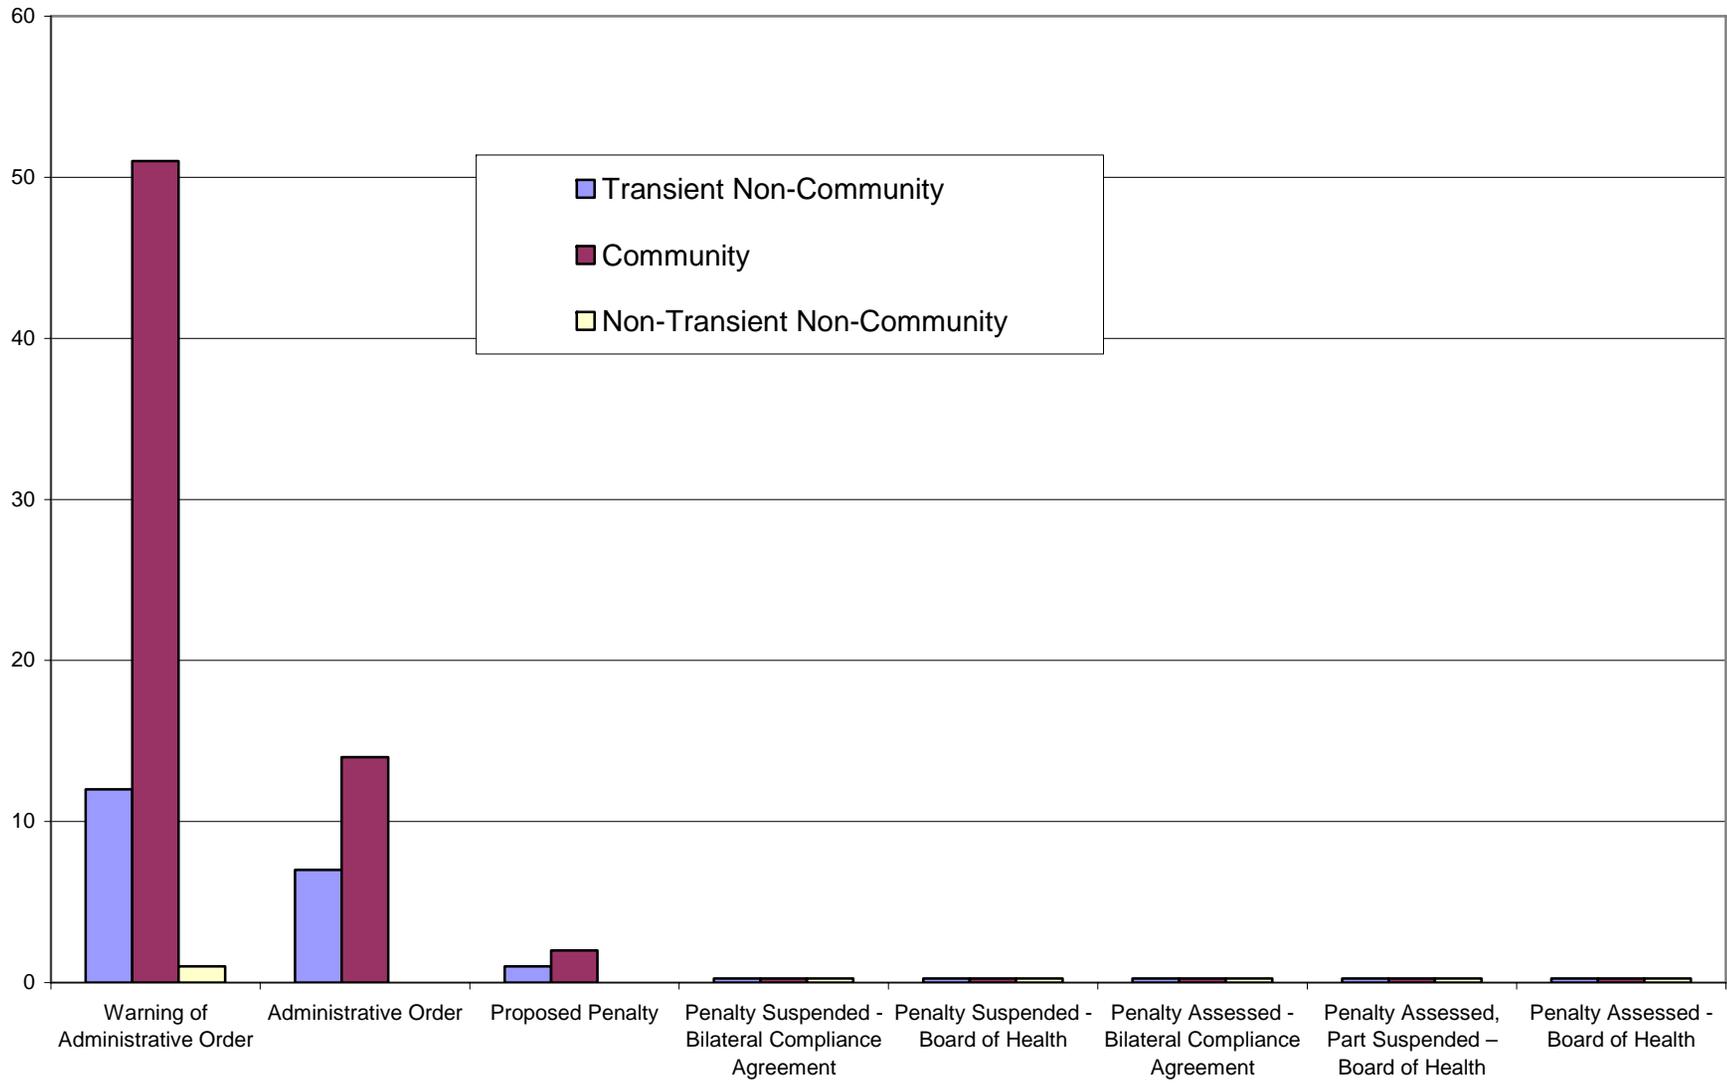

APPENDICES

APPENDICES

Appendix A - Microbiological Acute Maximum Contaminant Level Violations

PWS type:

PWS ID	System Name	SDWIS Code	Violation Date	Retail population
---------------	--------------------	-------------------	-----------------------	--------------------------

June 25, 2009

Appendix A

Appendix B - Microbiological Maximum Contaminant Level Violations

PWS type: C

<i>PWS ID2</i>	<i>System Name</i>	<i>SDWIS Code</i>	<i>Violation Date</i>	<i>Retail population</i>
303	ALICIA WATER SYSTEM	22	4/1/2008	173
006	ALMYRA WATERWORKS	22	8/1/2008	364
844	BEAVERFORK VOLUNTEER FD WSD	22	9/1/2008	2667
039	BELLA VISTA POA	22	10/1/2008	25398
041	BENTONVILLE WATER UTILITIES	22	8/1/2008	30894
871	BENTON-WASHINGTON REGIONAL PWA	22	8/1/2008	0
627	BETHESDA WATER ASSOCIATION	22	11/1/2008	1270
476	BIGGERS WATERWORKS	22	5/1/2008	404
551	CALION WATER WORKS	22	12/1/2008	732
789	CHERRY HILL PUBLIC FACILITY BD	22	5/1/2008	726
789	CHERRY HILL PUBLIC FACILITY BD	22	7/1/2008	726
564	CLINTON WATERWORKS	22	5/1/2008	6200
189	CONWAY WATER SYSTEM	22	11/1/2008	52000
459	CROSS COUNTY RURAL WATER SYS	22	8/1/2008	12075
008	DEWITT WATERWORKS	22	9/1/2008	3623
809	EAST LOGAN CO RURAL WATER	22	10/1/2008	1775
458	EAST PRAIRIE CO WATER ASSOC	22	7/1/2008	711
550	EL DORADO WATERWORKS	22	4/1/2008	20698
550	EL DORADO WATERWORKS	22	6/1/2008	20698
016	FOUNTAIN HILL WATERWORKS	22	4/1/2008	923
316	GOULD MUNICIPAL WATER-SEWER	22	8/1/2008	1144
317	GRADY WATERWORKS	22	1/1/2008	397
738	GRAND PRAIRIE REGIONAL WATER	22	10/1/2008	13050
191	GREENBRIER WATERWORKS	22	6/1/2008	7088
191	GREENBRIER WATERWORKS	22	6/1/2008	7088
062	HARRISON WATERWORKS	22	9/1/2008	15820
255	HORSESHOE BEND WATERWORKS	22	6/1/2008	2131
797	HORSESHOE HOMES WATER ASSOC	22	12/1/2008	35
151	Horseshoe Lake Utilities	22	8/1/2008	680
884	HOSANNA HEIGHTS WATER	22	2/1/2008	79
010	HUMPHREY WATERWORKS	22	7/1/2008	700
010	HUMPHREY WATERWORKS	22	8/1/2008	700
774	INDEPENDENCE JACKSON REGIONAL	22	10/1/2008	2825

Friday, June 12, 2009

Appendix B

Appendix B - Microbiological Maximum Contaminant Level Violations

781	INDIAN SWITCH RURAL WATER ASSN	22	5/1/2008	730
640	JOHNSON TOWNSHIP WATER ASSOC	22	5/1/2008	838
552	JUNCTION CITY WATERWORKS	22	4/1/2008	831
552	JUNCTION CITY WATERWORKS	22	8/1/2008	831
552	JUNCTION CITY WATERWORKS	22	9/1/2008	831
869	KINGWOOD MHP	22	7/1/2008	64
824	LAKE TABLE ROCK ESTATES	22	1/1/2008	53
824	LAKE TABLE ROCK ESTATES	22	5/1/2008	53
362	LEACHVILLE WATERWORKS	22	12/1/2008	2376
313	LEE COUNTY WATER ASSOCIATION	22	11/1/2008	5020
299	LYNN WATERWORKS	22	12/1/2008	685
349	MADISON CO WATER FACILITIES BD	22	5/1/2008	7979
109	MAGNOLIA WATERWORKS	22	4/1/2008	11009
382	MARIE WATER SYSTEM	22	9/1/2008	135
637	MARVELL RURAL WATER ASSOC	22	4/1/2008	2500
118	MENIFEE WATER DEPARTMENT	22	7/1/2008	464
242	MINERAL SPRINGS WATERWORKS	22	8/1/2008	1250
184	MONTICELLO WATER DEPARTMENT	22	10/1/2008	11228
020	MONTROSE WATERWORKS	22	1/1/2008	612
020	MONTROSE WATERWORKS	22	12/1/2008	612
681	MORNING STAR WATER ASSOCIATION	22	6/1/2008	1325
681	MORNING STAR WATER ASSOCIATION	22	9/1/2008	1325
805	NASHVILLE RURAL WATER ASSOC	22	10/1/2008	5781
697	NE YELL COUNTY WATER ASSOC	22	10/1/2008	5705
391	NORMAN WATERWORKS	22	9/1/2008	850
331	NORTH CARBON CITY WATER ASSOC	22	9/1/2008	115
616	ODEN- PENCIL BLUFF WATER ASSN.	22	4/1/2008	343
616	ODEN- PENCIL BLUFF WATER ASSN.	22	5/1/2008	343
064	OMAHA WATERWORKS	22	11/1/2008	1133
091	PEACH ORCHARD WATERWORKS	22	6/1/2008	202
412	PERRY WATER SYSTEM	22	10/1/2008	658
445	POTTSVILLE WATER ASSOCIATION	22	8/1/2008	3900
105	QUITMAN WATERWORKS	22	10/1/2008	1454
329	RATCLIFF WATERWORKS	22	6/1/2008	1305
329	RATCLIFF WATERWORKS	22	9/1/2008	1305

Friday, June 12, 2009

Appendix B

Appendix B - Microbiological Maximum Contaminant Level Violations

093	RECTOR WATERWORKS	22	8/1/2008	2194
093	RECTOR WATERWORKS	22	9/1/2008	2194
985	RED BUD MOBILE HOME PARK	22	4/1/2008	42
252	Rock Moore Water Authority	22	11/1/2008	3999
870	SE BRADLEY CO WATER ASSN	22	5/1/2008	2330
590	SEARCY WATERWORKS	22	8/1/2008	28870
978	SOUTH PIKE CO. WATER	22	6/1/2008	150
575	SPRINGDALE WATER UTILITIES	22	8/1/2008	73685
355	SUMMIT WATERWORKS	22	6/1/2008	564
895	TANKSLEY APARTMENTS	22	1/1/2008	52
895	TANKSLEY APARTMENTS	22	12/1/2008	52
566	TONTITOWN WATERWORKS	22	9/1/2008	2250
566	TONTITOWN WATERWORKS	22	10/1/2008	2250
435	TRUMANN WATERWORKS	22	6/1/2008	6889
855	TWIN OAKS MOBILE HOME PARK	22	9/1/2008	35
142	VAN BUREN WATERWORKS	22	11/1/2008	17813
283	WABBASEKA WATERWORKS	22	6/1/2008	344
416	WEST HELENA WATER WORKS	22	8/1/2008	8336
319	YORKTOWN WATER ASSOCIATION	22	8/1/2008	7956

PWS type: N

PWS ID2 System Name	SDWIS Code	Violation Date	Retail population	
T0323	101 Great American Diner	22	7/1/2008	32
N0235	ALEXA SPRINGS WATER COMPANY	22	6/1/2008	30
T0039	ARK ST PARK-LAKE MILLWOOD	22	9/1/2008	25
948	BACKWOODS BARN RESTAURANT	22	8/1/2008	100
T1070	Benny's Country Store	22	10/1/2008	30
T1070	Benny's Country Store	22	11/1/2008	30
T0091	BROOKHILL RANCH	22	6/1/2008	250
T0163	COUNTRY MOUNTAIN INN	22	5/1/2008	100
N0240	CULLIGAN'S WMSC3231 GREENWOOD	22	7/1/2008	30
T0244	HOLLER BACK GROCERY & FEED	22	5/1/2008	25
T0313	LAKE NORFORK INN	22	5/1/2008	25
T0313	LAKE NORFORK INN	22	7/1/2008	25
T0332	LITTLE PORTION RETREAT CENTER	22	6/1/2008	60
T0414	PARKWAY TRAVEL PARK	22	1/1/2008	30

Friday, June 12, 2009

Appendix B

Appendix B - Microbiological Maximum Contaminant Level Violations

T0414	PARKWAY TRAVEL PARK	22	7/1/2008	30
1016	PATSY'S ANTIQUES AND DELI	22	9/1/2008	25
T1038	RED BUD VALLEY RESORT	22	4/1/2008	25
T0469	RIVERVIEW MOTEL	22	11/1/2008	25
T0469	RIVERVIEW MOTEL	22	12/1/2008	25
958	SOUTHFORK RESORT	22	3/1/2008	50
T0855	THE WILD GOOSE STORE LLC	22	1/1/2008	50
T0811	USFS SHADY LAKE REC AREA 16666	22	5/1/2008	25
T0816	USFS SOUTH FOURCHE REC AREA	22	11/1/2008	25

PWS type: P

PWS ID2	System Name	SDWIS Code	Violation Date	Retail population
T1110	ARK STATE PARK MT MAGAZINE	22	8/1/2008	28
N0020	EL DORADO CHEMICAL COMPANY	22	9/1/2008	150
N0029	Great Lakes Chemical South	22	3/1/2008	240

Friday, June 12, 2009

Appendix B

Appendix C - Microbiological Monitoring - No Valid Samples

PWS type: C

PWS ID2 System Name	SDWIS Code	Violation Date	Retail population
764 ALPINE WATER ASSOCIATION	23	6/1/2008	675
721 AURELLE WATER SYSTEM	23	11/1/2008	295
913 BENTON COUNTY WATER AUTHORITY5	23	12/1/2008	1147
026 BIG FLAT WATERWORKS	23	2/1/2008	523
731 BIGGERS BLUFF DEVELOPMENT	23	10/1/2008	133
123 BLACK OAK WATERWORKS	23	8/1/2008	270
587 BRADFORD WATERWORKS	23	8/1/2008	800
587 BRADFORD WATERWORKS	23	9/1/2008	800
515 CADDO VALLEY WATERWORKS	23	3/1/2008	788
919 CALHOUN COUNTY WATER ASSN	23	11/1/2008	1388
130 CASH WATERWORKS	23	8/1/2008	364
669 COMPTON WATERWORKS	23	10/1/2008	811
596 COTTON PLANT WATERWORKS	23	8/1/2008	960
199 DENNING WATERWORKS	23	11/1/2008	788
199 DENNING WATERWORKS	23	12/1/2008	788
809 EAST LOGAN CO RURAL WATER	23	2/1/2008	1775
768 EAST NEWTON COUNTY WATER ASSN	23	12/1/2008	1528
458 EAST PRAIRIE CO WATER ASSOC	23	5/1/2008	711
458 EAST PRAIRIE CO WATER ASSOC	23	11/1/2008	711
075 EUREKA SPRINGS WATERWORKS	23	11/1/2008	2500
046 FIFTY SIX WATERWORKS	23	12/1/2008	562
812 FREEDOM WATER ASSOCIATION	23	11/1/2008	1708
034 GASSVILLE WATERWORKS	23	5/1/2008	1547
861 GLENHAVEN YOUTH RANCH	23	2/1/2008	50
097 GREENWAY WATERWORKS	23	1/1/2008	444
070 HAMPTON WATERWORKS	23	11/1/2008	1730
159 HICKORY RIDGE WATERWORKS	23	7/1/2008	364
547 HWY 82 WATER ASSOCIATION	23	7/1/2008	124
122 LAKE CITY WATERWORKS	23	8/1/2008	2136
420 LAKEVIEW MUNICIPAL WATER	23	12/1/2008	575
032 LEISURE HILLS HOMEOWNERS ASSOC	23	12/1/2008	131
747 LEISURE HILLS MOBILE HOME PARK	23	12/1/2008	117
297 LEWISVILLE WATERWORKS	23	7/1/2008	1800
409 MILLWOOD WATER CORPORATION	23	7/1/2008	495
864 MT MORIAH WATER DISTRICT	23	1/1/2008	113
864 MT MORIAH WATER DISTRICT	23	10/1/2008	113

Thursday, June 25, 2009

Appendix C

Appendix C - Microbiological Monitoring - No Valid Samples

864	MT MORIAH WATER DISTRICT	23	11/1/2008	113
676	OAKHILLS SURB IMPROVMENT DIST	23	10/1/2008	107
832	OSAGE POINT MHP	23	6/1/2008	54
802	OUTSIDE KINGSLAND WATER ASSOC	23	7/1/2008	525
623	PERLA WATER ASSOCIATION	23	3/1/2008	1875
623	PERLA WATER ASSOCIATION	23	4/1/2008	1875
818	PIKE CITY WATER ASSN	23	11/1/2008	300
354	PYATT WATERWORKS	23	8/1/2008	213
354	PYATT WATERWORKS	23	12/1/2008	213
105	QUITMAN WATERWORKS	23	4/1/2008	1454
329	RATCLIFF WATERWORKS	23	4/1/2008	1305
084	READLAND-GRANDLAKE WATER ASSOC	23	7/1/2008	237
758	SDM WATER ASSOCIATION	23	11/1/2008	373
528	SIDNEY WATER SYSTEM	23	11/1/2008	313
836	ST FRANCIS RIVER REG WATER DD	23	1/1/2008	2375
556	STRONG WATERWORKS	23	11/1/2008	992
057	SULPHUR SPRINGS WATERWORKS	23	10/1/2008	720
266	TUCKERMAN WATERWORKS	23	2/1/2008	1944
137	VANDERVOORT WATERWORKS	23	10/1/2008	638
735	WEST STONE COUNTY WATER ASSN	23	10/1/2008	4634
806	WIEDERKEHR VILLAGE WATER DEPT	23	11/1/2008	70
806	WIEDERKEHR VILLAGE WATER DEPT	23	12/1/2008	70
642	WINTHROP WATER ASSOCIATION	23	4/1/2008	375
356	YELLVILLE WATERWORKS	23	12/1/2008	2322

PWS type: N

PWS ID2 System Name	SDWIS Code	Violation Date	Retail population	
T0323	101 Great American Diner	23	8/1/2008	32
T0323	101 Great American Diner	23	9/1/2008	32
T0323	101 Great American Diner	23	10/1/2008	32
T0323	101 Great American Diner	23	12/1/2008	32
T1054	62 Food Mart	23	1/1/2008	25
T1054	62 Food Mart	23	7/1/2008	25
T1066	A M-N CONVENIENCE STORE	23	7/1/2008	30
T0171	ANGLERS GRILL	23	8/1/2008	50
T0171	ANGLERS GRILL	23	9/1/2008	50
960	ANTIOCH CHURCH	23	8/1/2008	
1014	Aqua Polar Trumann	23	1/1/2008	30
1014	Aqua Polar Trumann	23	2/1/2008	30

Thursday, June 25, 2009

Appendix C

Appendix C - Microbiological Monitoring - No Valid Samples

1014	Aqua Polar Trumann	23	4/1/2008	30
1014	Aqua Polar Trumann	23	5/1/2008	30
T0031	ARK POST NATIONAL MEMORIAL	23	9/1/2008	25
T0045	ARK ST PARK-QUEEN WILHELMENA	23	6/1/2008	200
T0057	BAIN'S GROCERY	23	7/1/2008	25
T0057	BAIN'S GROCERY	23	10/1/2008	25
T0061	BARN CAFÉ	23	3/1/2008	25
T0083	BOGG SPRINGS BAPTIST CAMP	23	9/1/2008	800
T1083	BRADY MOUNTAIN RESORT & MARINA	23	1/1/2008	1000
T1083	BRADY MOUNTAIN RESORT & MARINA	23	10/1/2008	1000
T0091	BROOKHILL RANCH	23	8/1/2008	250
T0102	BYRD'S CANOE RENTAL	23	10/1/2008	25
T0114	CAMP CANFIELD	23	8/1/2008	100
T1003	CEDAR FALLS MOTEL	23	5/1/2008	25
T1003	CEDAR FALLS MOTEL	23	6/1/2008	25
T1003	CEDAR FALLS MOTEL	23	9/1/2008	25
T1003	CEDAR FALLS MOTEL	23	11/1/2008	25
986	CEDAR GLADES PARK	23	1/1/2008	25
986	CEDAR GLADES PARK	23	3/1/2008	25
986	CEDAR GLADES PARK	23	5/1/2008	25
931	CEDAR RIDGE COUNTRY CUPBOARD	23	6/1/2008	25
931	CEDAR RIDGE COUNTRY CUPBOARD	23	11/1/2008	25
T1057	COBB'S CORNER MARKET	23	2/1/2008	50
T0178	CRYSTAL MTN MEX RESTAURANT	23	4/1/2008	150
T0178	CRYSTAL MTN MEX RESTAURANT	23	7/1/2008	150
T0178	CRYSTAL MTN MEX RESTAURANT	23	10/1/2008	150
999	Culligan Ranchito2 Rogers	23	2/1/2008	30
N0186	CULLIGAN WATER CONDITIONING	23	1/1/2008	30
N0186	CULLIGAN WATER CONDITIONING	23	4/1/2008	30
N0186	CULLIGAN WATER CONDITIONING	23	5/1/2008	30
1028	Culligan WMSC 4460 NLR	23	6/1/2008	30
1017	Culligan WMSC0388 Fort Smith	23	3/1/2008	30
1017	Culligan WMSC0388 Fort Smith	23	4/1/2008	30
983	Culligan WMSC2587 Cabot	23	2/1/2008	30
N0200	CULLIGAN'S CONWAY WALMART 2575	23	11/1/2008	30
N0145	CULLIGAN'S CONWAY WAL-MART005	23	11/1/2008	30
N0212	CULLIGAN'S HARP'S 135	23	5/1/2008	30
N0212	CULLIGAN'S HARP'S 135	23	10/1/2008	30
N0158	CULLIGAN'S HARRISON WAL-MAR2	23	2/1/2008	30

Thursday, June 25, 2009

Appendix C

Appendix C - Microbiological Monitoring - No Valid Samples

N0198	CULLIGAN'S JACKSONVILLE WALM24	23	2/1/2008	30
N0140	CULLIGAN'S MENA WAL-MART 0067	23	1/1/2008	30
N0140	CULLIGAN'S MENA WAL-MART 0067	23	8/1/2008	30
N0143	CULLIGAN'S MORRILTON WAL-MAR8	23	6/1/2008	30
N0143	CULLIGAN'S MORRILTON WAL-MAR8	23	11/1/2008	30
N0148	CULLIGAN'S RUSSELLVILLE HARPS	23	1/1/2008	30
N0230	CULLIGAN'S WMSC0011 MT HOME	23	5/1/2008	30
N0230	CULLIGAN'S WMSC0011 MT HOME	23	10/1/2008	30
947	CULLIGAN'S WMSC0127 MALVERN	23	3/1/2008	30
947	CULLIGAN'S WMSC0127 MALVERN	23	11/1/2008	30
963	CULLIGAN'S WMSC0296 DARDANELLE	23	2/1/2008	30
N0220	CULLIGAN'S WMSC0788 CLINTON	23	6/1/2008	30
964	CULLIGAN'S WMSC1114 MTN VIEW	23	5/1/2008	30
964	CULLIGAN'S WMSC1114 MTN VIEW	23	10/1/2008	30
944	CULLIGAN'S WMSC1147 FLIPPIN	23	1/1/2008	30
944	CULLIGAN'S WMSC1147 FLIPPIN	23	5/1/2008	30
N0240	CULLIGAN'S WMSC3231 GREENWOOD	23	1/1/2008	30
929	CULLIGAN'S WMSC5244 L R	23	6/1/2008	30
929	CULLIGAN'S WMSC5244 L R	23	11/1/2008	30
T0204	ECHO POINT RESORT	23	1/1/2008	25
T0204	ECHO POINT RESORT	23	2/1/2008	25
T0204	ECHO POINT RESORT	23	3/1/2008	25
T0204	ECHO POINT RESORT	23	4/1/2008	25
T0204	ECHO POINT RESORT	23	5/1/2008	25
T0204	ECHO POINT RESORT	23	6/1/2008	25
T1105	EUREKA MUSIC PARK	23	1/1/2008	25
T1105	EUREKA MUSIC PARK	23	2/1/2008	25
T1105	EUREKA MUSIC PARK	23	3/1/2008	25
T1105	EUREKA MUSIC PARK	23	10/1/2008	25
T0216	FISH BOWL RESTAURANT	23	2/1/2008	100
T0216	FISH BOWL RESTAURANT	23	9/1/2008	100
T0216	FISH BOWL RESTAURANT	23	11/1/2008	100
T0052	FOXY LADY CLUB	23	1/1/2008	30
T0052	FOXY LADY CLUB	23	2/1/2008	30
T0563	FREEDOM RV PARK	23	6/1/2008	25
T0563	FREEDOM RV PARK	23	11/1/2008	25
T0932	GASKINS CABIN STEAKHOUSE RESTAURANT	23	11/1/2008	75
T0231	GASTON'S WHITE RIVER RESORT	23	5/1/2008	550
972	GENERAL WATER CONDITIONING	23	5/1/2008	30

Thursday, June 25, 2009

Appendix C

Appendix C - Microbiological Monitoring - No Valid Samples

972	GENERAL WATER CONDITIONING	23	9/1/2008	30
972	GENERAL WATER CONDITIONING	23	11/1/2008	30
972	GENERAL WATER CONDITIONING	23	12/1/2008	30
926	GIFT-TIQUES	23	4/1/2008	25
T1045	GIRL SCOUT CAMP KARLTON KEMP	23	9/1/2008	25
1035	Glacier Alco411 HS	23	8/1/2008	30
1056	GLACIER CRANFORD'S RISON	23	10/1/2008	30
1024	Glacier HF1684 LR	23	8/1/2008	30
1038	Glacier HF1688 Benton	23	5/1/2008	30
1038	Glacier HF1688 Benton	23	8/1/2008	30
1022	Glacier HF1706 LR	23	8/1/2008	30
1037	Glacier HF6046 Sherwood	23	8/1/2008	30
1030	GLACIER HF6080 LR	23	10/1/2008	30
1026	Glacier HF6167 LR	23	10/1/2008	30
1020	Glacier HF6243 LR	23	8/1/2008	30
1032	Glacier HF6249 NLR	23	10/1/2008	30
1039	GLACIER HF6282 BENTON	23	5/1/2008	30
1039	GLACIER HF6282 BENTON	23	8/1/2008	30
1021	Glacier HF6320 LR	23	8/1/2008	30
1023	Glacier Supermercado LR	23	8/1/2008	30
916	GLACIER WATER BG PB 9865	23	10/1/2008	30
T0611	H K THATCHER LOCK AND DAM	23	12/1/2008	25
981	HARVEST CHURCH	23	1/1/2008	25
T0258	HOLIDAY HILLS RESORT	23	10/1/2008	25
T0433	IRON HORSE STABLE INC	23	10/1/2008	100
T0381	J & P FLASH MARKET #105	23	11/1/2008	500
1043	JIM'S SALOON	23	7/1/2008	25
T1080	JOHNSON'S MR K FOODS	23	4/1/2008	250
T1080	JOHNSON'S MR K FOODS	23	6/1/2008	250
T1080	JOHNSON'S MR K FOODS	23	12/1/2008	250
T0295	KELLER'S KOVE RESORT	23	1/1/2008	150
T0295	KELLER'S KOVE RESORT	23	7/1/2008	150
1003	Kidzone Pre-School and Daycare	23	3/1/2008	25
1003	Kidzone Pre-School and Daycare	23	4/1/2008	25
1003	Kidzone Pre-School and Daycare	23	7/1/2008	25
T1055	KING'S RIVER COUNTRY STORE	23	11/1/2008	25
1040	KINGSTON STATION	23	12/1/2008	75
910	LAKE NORFORK QUICK STOP	23	5/1/2008	25
T0326	LESTER FLATT MEMORIAL PARK	23	9/1/2008	25

Thursday, June 25, 2009

Appendix C

Appendix C - Microbiological Monitoring - No Valid Samples

T0530	MAYE'S GROCERY	23	10/1/2008	25
T0922	MEDALLION FOODS	23	10/1/2008	100
T0870	MILLWOOD COUNTRY CLUB	23	6/1/2008	125
T0870	MILLWOOD COUNTRY CLUB	23	7/1/2008	125
T0870	MILLWOOD COUNTRY CLUB	23	11/1/2008	125
982	MULBERRY RIVER MOUNTAIN RANCH	23	8/1/2008	25
982	MULBERRY RIVER MOUNTAIN RANCH	23	9/1/2008	25
T0465	OUACHITA LIVESTOCK MARKET	23	1/1/2008	25
T0465	OUACHITA LIVESTOCK MARKET	23	4/1/2008	25
T0465	OUACHITA LIVESTOCK MARKET	23	10/1/2008	25
1015	Ozark mountain Gallery	23	8/1/2008	25
T0411	PACKSADDLE RESTAURANT	23	1/1/2008	25
T0413	PARKS SENIOR CENTER	23	1/1/2008	43
1016	PATSY'S ANTIQUES AND DELI	23	7/1/2008	25
T0417	PEA RIDGE NATL MILITARY PARK	23	5/1/2008	25
T0426	PIER 27	23	9/1/2008	25
T0426	PIER 27	23	12/1/2008	25
1009	Pilgrimage Christian Center	23	10/1/2008	50
T0290	RAZORBACK RESTAURANT	23	11/1/2008	100
936	RIVERSIDE RETREAT	23	6/1/2008	25
T0469	RIVERVIEW MOTEL	23	10/1/2008	25
T0470	ROADRUNNER INN	23	9/1/2008	25
T0476	ROGER'S BOY SCOUT CAMP	23	9/1/2008	25
T1097	ROOST YOUR WHEELS	23	4/1/2008	25
T1097	ROOST YOUR WHEELS	23	10/1/2008	25
T0492	SCOTT VALLEY DUDE RANCH	23	5/1/2008	35
T0492	SCOTT VALLEY DUDE RANCH	23	6/1/2008	35
T0492	SCOTT VALLEY DUDE RANCH	23	7/1/2008	35
T1071	SHADY GROVE STORE	23	3/1/2008	30
T1076	SPILLWAY RESORT MARINA	23	4/1/2008	100
T0516	SPRUPELL-BECKHAM RESTAURANT	23	6/1/2008	50
T0516	SPRUPELL-BECKHAM RESTAURANT	23	12/1/2008	50
T1109	SUGAR CREEK LODGE	23	1/1/2008	25
T0524	SUNRISE POINT RESORT	23	7/1/2008	76
T0524	SUNRISE POINT RESORT	23	8/1/2008	76
T0524	SUNRISE POINT RESORT	23	12/1/2008	76
945	SUPERLIFT ORV PARK	23	11/1/2008	50
T0526	SUPPLY COUNTRY STORE	23	4/1/2008	150
1047	T & T DOLLAR STORE FS	23	7/1/2008	30

Thursday, June 25, 2009

Appendix C

Appendix C - Microbiological Monitoring - No Valid Samples

1047	T & T DOLLAR STORE FS	23	8/1/2008	30
1047	T & T DOLLAR STORE FS	23	11/1/2008	30
1010	Taylor Jam	23	3/1/2008	25
T0208	THE LAKEHOUSE	23	1/1/2008	30
T0208	THE LAKEHOUSE	23	11/1/2008	30
T1108	THE ROADHOUSE	23	3/1/2008	25
T1108	THE ROADHOUSE	23	11/1/2008	25
T0855	THE WILD GOOSE STORE LLC	23	4/1/2008	50
T0550	THREE OAKS RESORT	23	5/1/2008	40
T0591	USCOE BSWP117 OZARK ISLE	23	5/1/2008	25
T0594	USCOE BSWP133 HIGHWAY 125	23	6/3/2008	25
T0602	USCOE BWP 18 LOST BRIDGE SOUTH	23	6/1/2008	25
T0629	USCOE DKW3 BLUE RIDGE	23	9/1/2008	25
T1053	USCOE NF HOWARD COVE	23	7/1/2008	100
T1053	USCOE NF HOWARD COVE	23	11/1/2008	100
T0766	USFS BAYOU BLUFF	23	5/1/2008	25
T0795	USFS LAKE WEDINGTON	23	11/1/2008	50
1002	War Eagle Cavern	23	5/1/2008	25
949	WEST SHORE RESTAURANT	23	8/1/2008	150
T0852	WHITE RIVER CAMPGROUND	23	2/1/2008	250
T0852	WHITE RIVER CAMPGROUND	23	6/1/2008	250
T0852	WHITE RIVER CAMPGROUND	23	11/1/2008	250

PWS type: P

PWS ID2 System Name	SDWIS Code	Violation Date	Retail population	
N0014	BRUNO PYATT SCHOOL	23	8/1/2008	300
N0009	ENTERGY - INDEPENDENCE	23	8/1/2008	200
N0134	NSC INTERNATIONAL	23	5/1/2008	31
N0109	SW REGION WILDERNESS CAMP	23	5/1/2008	59
N0109	SW REGION WILDERNESS CAMP	23	7/1/2008	59
N0065	UMPIRE HIGH SCHOOL	23	8/1/2008	140

Thursday, June 25, 2009

Appendix C

Appendix D - Microbiological Monitoring - No resamples of Positive Samples

PWS type: C

PWS ID2 System Name	SDWIS Code	Violation Date	Retail population
303 ALICIA WATER SYSTEM	25	1/1/2008	173
519 BEN LOMOND WATERWORKS	25	3/1/2008	161
159 HICKORY RIDGE WATERWORKS	25	6/1/2008	364
373 KEISER WATERWORKS	25	12/1/2008	893
020 MONTROSE WATERWORKS	25	2/1/2008	612
703 MT ZION WATER ASSOCIATION	25	5/1/2008	202
703 MT ZION WATER ASSOCIATION	25	7/1/2008	202
703 MT ZION WATER ASSOCIATION	25	10/1/2008	202
703 MT ZION WATER ASSOCIATION	25	12/1/2008	202
793 NORFORK LAKE ESTATES WATER SYS	25	5/1/2008	91
105 QUITMAN WATERWORKS	25	7/1/2008	1454
283 WABBASEKA WATERWORKS	25	1/1/2008	344

PWS type: N

PWS ID2 System Name	SDWIS Code	Violation Date	Retail population
T0323 101 Great American Diner	25	3/1/2008	32
T0323 101 Great American Diner	25	5/1/2008	32
T1054 62 Food Mart	25	10/1/2008	25
T0015 AHTD-LONSDALE REST AREA	25	5/1/2008	25
960 ANTIOCH CHURCH	25	9/1/2008	
960 ANTIOCH CHURCH	25	10/1/2008	
T0039 ARK ST PARK-LAKE MILLWOOD	25	8/1/2008	25
T0061 BARN CAFÉ	25	11/1/2008	25
986 CEDAR GLADES PARK	25	6/1/2008	25
986 CEDAR GLADES PARK	25	7/1/2008	25
986 CEDAR GLADES PARK	25	11/1/2008	25
T0563 FREEDOM RV PARK	25	7/1/2008	25
T1045 GIRL SCOUT CAMP KARLTON KEMP	25	10/1/2008	25
T0244 HOLLER BACK GROCERY & FEED	25	10/1/2008	25
T0908 K & S Grocery	25	4/1/2008	25
910 LAKE NORFORK QUICK STOP	25	7/1/2008	25
910 LAKE NORFORK QUICK STOP	25	8/1/2008	25
910 LAKE NORFORK QUICK STOP	25	12/1/2008	25
T0414 PARKWAY TRAVEL PARK	25	12/1/2008	30
1016 PATSY'S ANTIQUES AND DELI	25	8/1/2008	25
T1038 RED BUD VALLEY RESORT	25	7/1/2008	25
T1038 RED BUD VALLEY RESORT	25	12/1/2008	25
989 Sean's Restaurant	25	4/1/2008	25
T1076 SPILLWAY RESORT MARINA	25	7/1/2008	100
T0516 SPRUELL-BECKHAM RESTAURANT	25	7/1/2008	50

Appendix E - Surface Water Treatment Rule Monitoring

PWS type: C

PWS ID2 System Name	SDWIS Code	Violation Date	Retail population
811 ACORN RURAL WATER ASSN	36	12/1/2008	1743
863 ALL SEASONS MHP	36	1/1/2008	56
863 ALL SEASONS MHP	36	2/1/2008	56
863 ALL SEASONS MHP	36	3/1/2008	56
863 ALL SEASONS MHP	36	4/1/2008	56
871 BENTON-WASHINGTON REGIONAL PWA	36	8/1/2008	0
603 DANVILLE WATERWORKS	36	2/1/2008	2693
601 DARDANELLE WATERWORKS	36	4/1/2008	4190
580 PANGBURN WATERWORKS	36	1/1/2008	2464
580 PANGBURN WATERWORKS	36	2/1/2008	2464
605 PLAINVIEW WATER DEPARTMENT	36	1/1/2008	1083
105 QUITMAN WATERWORKS	36	5/1/2008	1454
985 RED BUD MOBILE HOME PARK	36	8/1/2008	42
985 RED BUD MOBILE HOME PARK	36	9/1/2008	42
985 RED BUD MOBILE HOME PARK	36	10/1/2008	42
985 RED BUD MOBILE HOME PARK	36	11/1/2008	42
985 RED BUD MOBILE HOME PARK	36	12/1/2008	42
137 VANDERVOORT WATERWORKS	36	5/1/2008	638

PWS type: N

PWS ID2 System Name	SDWIS Code	Violation Date	Retail population
T0045 ARK ST PARK-QUEEN WILHELMENA	36	12/1/2008	200
1040 KINGSTON STATION	36	11/1/2008	75
T0852 WHITE RIVER CAMPGROUND	36	12/1/2008	250

Thursday, June 25, 2009

Appendix E

Appendix F - Surface Water Treatment Rule Treatment Technique Violations

PWS type: C

PWS ID2	System Name	SDWIS Code	Violation Date	Retail population
441	ATKINS WATER SYSTEM	41	11/1/2008	2278
670	DEER WATER ASSOCIATION	41	11/1/2008	855
670	DEER WATER ASSOCIATION	41	12/1/2008	855
552	JUNCTION CITY WATERWORKS	41	3/1/2008	831
552	JUNCTION CITY WATERWORKS	41	3/1/2008	831
025	MOUNTAIN HOME WATERWORKS	41	6/1/2008	15408
025	MOUNTAIN HOME WATERWORKS	41	6/1/2008	15408
136	MULBERRY WATERWORKS	41	9/1/2008	1627
391	NORMAN WATERWORKS	41	6/1/2008	850
826	NORTH PIKE CO RURAL WATER ASSN	41	10/1/2008	1945
826	NORTH PIKE CO RURAL WATER ASSN	41	10/1/2008	1945
605	PLAINVIEW WATER DEPARTMENT	41	5/1/2008	1083
605	PLAINVIEW WATER DEPARTMENT	41	6/1/2008	1083
605	PLAINVIEW WATER DEPARTMENT	41	7/1/2008	1083
307	STRAWBERRY WATERWORKS	41	4/1/2008	903
307	STRAWBERRY WATERWORKS	41	4/1/2008	903

PWS type: P

PWS ID2	System Name	SDWIS Code	Violation Date	Retail population
N0072	ALMATIS	41	1/1/2008	225

Thursday, June 25, 2009

Appendix F

Appendix G - Chemical Maximum Contaminant Level Violation

PWS type: C

PWS ID	System Name	SDWIS Code	Violation Definition	Violation Date	Retail population
144	ALMA WATERWORKS	2456	Maximum Contaminant Level Violation for Total Haloacetic Acids (HAA5)	4/1/2008	5415
844	BEAVERFORK VOLUNTEER FD WSD	2456	Maximum Contaminant Level Violation for Total Haloacetic Acids (HAA5)	10/1/2008	2667
887	BODCAW RURAL WATER SYSTEM	2950	Maximum Contaminant Level Violation for TTHM	10/1/2008	1250
326	BOONEVILLE WATERWORKS	2950	Maximum Contaminant Level Violation for TTHM	1/1/2008	4119
326	BOONEVILLE WATERWORKS	2950	Maximum Contaminant Level Violation for TTHM	4/1/2008	4119
326	BOONEVILLE WATERWORKS	2950	Maximum Contaminant Level Violation for TTHM	7/1/2008	4119
653	BRANCH WATER WORKS	2950	Maximum Contaminant Level Violation for TTHM	1/1/2008	500
653	BRANCH WATER WORKS	2950	Maximum Contaminant Level Violation for TTHM	4/1/2008	500
653	BRANCH WATER WORKS	2950	Maximum Contaminant Level Violation for TTHM	7/1/2008	500
653	BRANCH WATER WORKS	2950	Maximum Contaminant Level Violation for TTHM	10/1/2008	500
486	BRYANT WATERWORKS	2950	Maximum Contaminant Level Violation for TTHM	1/1/2008	14635
486	BRYANT WATERWORKS	2950	Maximum Contaminant Level Violation for TTHM	4/1/2008	14635
737	BUENA VISTA-OGEMAW WATER ASSOC	2950	Maximum Contaminant Level Violation for TTHM	1/1/2008	794
737	BUENA VISTA-OGEMAW WATER ASSOC	2456	Maximum Contaminant Level Violation for Total Haloacetic Acids (HAA5)	1/1/2008	794

Thursday, June 25, 2009

Appendix G

Appendix G - Chemical Maximum Contaminant Level Violation

737	BUENA VISTA-OGEMAW WATER ASSOC	2950	Maximum Contaminant Level Violation for TTHM	10/1/2008	794
737	BUENA VISTA-OGEMAW WATER ASSOC	2456	Maximum Contaminant Level Violation for Total Haloacetic Acids (HAA5)	10/1/2008	794
404	CAMDEN WATERWORKS	2456	Maximum Contaminant Level Violation for Total Haloacetic Acids (HAA5)	4/1/2008	13010
404	CAMDEN WATERWORKS	2456	Maximum Contaminant Level Violation for Total Haloacetic Acids (HAA5)	7/1/2008	13010
404	CAMDEN WATERWORKS	2456	Maximum Contaminant Level Violation for Total Haloacetic Acids (HAA5)	10/1/2008	13010
404	CAMDEN WATERWORKS	2950	Maximum Contaminant Level Violation for TTHM	10/1/2008	13010
660	CASA WATER DEPT	2950	Maximum Contaminant Level Violation for TTHM	1/1/2008	1200
660	CASA WATER DEPT	2950	Maximum Contaminant Level Violation for TTHM	4/1/2008	1200
660	CASA WATER DEPT	2950	Maximum Contaminant Level Violation for TTHM	7/1/2008	1200
660	CASA WATER DEPT	2950	Maximum Contaminant Level Violation for TTHM	10/1/2008	1200
789	CHERRY HILL PUBLIC FACILITY BD	2950	Maximum Contaminant Level Violation for TTHM	1/1/2008	726
789	CHERRY HILL PUBLIC FACILITY BD	2950	Maximum Contaminant Level Violation for TTHM	4/1/2008	726
789	CHERRY HILL PUBLIC FACILITY BD	2950	Maximum Contaminant Level Violation for TTHM	7/1/2008	726
789	CHERRY HILL PUBLIC FACILITY BD	2950	Maximum Contaminant Level Violation for TTHM	10/1/2008	726
603	DANVILLE WATERWORKS	2950	Maximum Contaminant Level Violation for TTHM	1/1/2008	2693

Thursday, June 25, 2009

Appendix G

Appendix G - Chemical Maximum Contaminant Level Violation

603	DANVILLE WATERWORKS	2950	Maximum Contaminant Level Violation for TTHM	4/1/2008	2693
143	DYER WATERWORKS	2456	Maximum Contaminant Level Violation for Total Haloacetic Acids (HAA5)	4/1/2008	1000
143	DYER WATERWORKS	2950	Maximum Contaminant Level Violation for TTHM	7/1/2008	1000
143	DYER WATERWORKS	2950	Maximum Contaminant Level Violation for TTHM	10/1/2008	1000
768	EAST NEWTON COUNTY WATER ASSN	1025	Maximum Contaminant Level Violation for Fluoride	10/1/2008	1528
004	FORREST CITY WATERWORKS	2984	Maximum Contaminant Level Violation for Trichloroethylene	4/1/2008	14060
004	FORREST CITY WATERWORKS	2984	Maximum Contaminant Level Violation for Trichloroethylene	10/1/2008	14060
016	FOUNTAIN HILL WATERWORKS	2950	Maximum Contaminant Level Violation for TTHM	4/1/2008	923
016	FOUNTAIN HILL WATERWORKS	2950	Maximum Contaminant Level Violation for TTHM	7/1/2008	923
016	FOUNTAIN HILL WATERWORKS	2950	Maximum Contaminant Level Violation for TTHM	10/1/2008	923
636	FRENCHPORT WATER ASSOCIATION	2950	Maximum Contaminant Level Violation for TTHM	10/1/2008	1783
658	GILLHAM REGIONAL WATER DIST	2950	Maximum Contaminant Level Violation for TTHM	1/1/2008	0
658	GILLHAM REGIONAL WATER DIST	2950	Maximum Contaminant Level Violation for TTHM	4/1/2008	0
658	GILLHAM REGIONAL WATER DIST	2950	Maximum Contaminant Level Violation for TTHM	7/1/2008	0
658	GILLHAM REGIONAL WATER DIST	2950	Maximum Contaminant Level Violation for TTHM	10/1/2008	0

Thursday, June 25, 2009

Appendix G

Appendix G - Chemical Maximum Contaminant Level Violation

191	GREENBRIER WATERWORKS	2950	Maximum Contaminant Level Violation for TTHM	1/1/2008	7088
191	GREENBRIER WATERWORKS	2456	Maximum Contaminant Level Violation for Total Haloacetic Acids (HAA5)	4/1/2008	7088
191	GREENBRIER WATERWORKS	2950	Maximum Contaminant Level Violation for TTHM	4/1/2008	7088
191	GREENBRIER WATERWORKS	2456	Maximum Contaminant Level Violation for Total Haloacetic Acids (HAA5)	7/1/2008	7088
191	GREENBRIER WATERWORKS	2950	Maximum Contaminant Level Violation for TTHM	7/1/2008	7088
191	GREENBRIER WATERWORKS	2456	Maximum Contaminant Level Violation for Total Haloacetic Acids (HAA5)	10/1/2008	7088
504	GREENWOOD WATERWORKS	2950	Maximum Contaminant Level Violation for TTHM	1/1/2008	8290
504	GREENWOOD WATERWORKS	2950	Maximum Contaminant Level Violation for TTHM	4/1/2008	8290
504	GREENWOOD WATERWORKS	2950	Maximum Contaminant Level Violation for TTHM	7/1/2008	8290
504	GREENWOOD WATERWORKS	2950	Maximum Contaminant Level Violation for TTHM	10/1/2008	8290
436	HATFIELD WATERWORKS	2950	Maximum Contaminant Level Violation for TTHM	1/1/2008	782
436	HATFIELD WATERWORKS	2950	Maximum Contaminant Level Violation for TTHM	4/1/2008	782
436	HATFIELD WATERWORKS	2950	Maximum Contaminant Level Violation for TTHM	7/1/2008	782
436	HATFIELD WATERWORKS	2950	Maximum Contaminant Level Violation for TTHM	10/1/2008	782
885	HIGHFILL WATER DEPARTMENT	2950	Maximum Contaminant Level Violation for TTHM	1/1/2008	1140

Thursday, June 25, 2009

Appendix G

Appendix G - Chemical Maximum Contaminant Level Violation

885	HIGHFILL WATER DEPARTMENT	2950	Maximum Contaminant Level Violation for TTHM	4/1/2008	1140
885	HIGHFILL WATER DEPARTMENT	2950	Maximum Contaminant Level Violation for TTHM	7/1/2008	1140
885	HIGHFILL WATER DEPARTMENT	2950	Maximum Contaminant Level Violation for TTHM	10/1/2008	1140
765	HWY 4 24 WATER ASSOCIATION	2950	Maximum Contaminant Level Violation for TTHM	1/1/2008	2179
765	HWY 4 24 WATER ASSOCIATION	2456	Maximum Contaminant Level Violation for Total Haloacetic Acids (HAA5)	1/1/2008	2179
765	HWY 4 24 WATER ASSOCIATION	2950	Maximum Contaminant Level Violation for TTHM	10/1/2008	2179
765	HWY 4 24 WATER ASSOCIATION	2456	Maximum Contaminant Level Violation for Total Haloacetic Acids (HAA5)	10/1/2008	2179
327	MAGAZINE WATERWORKS	2950	Maximum Contaminant Level Violation for TTHM	4/1/2008	1115
327	MAGAZINE WATERWORKS	2950	Maximum Contaminant Level Violation for TTHM	7/1/2008	1115
327	MAGAZINE WATERWORKS	2950	Maximum Contaminant Level Violation for TTHM	10/1/2008	1115
193	MAYFLOWER WATERWORKS	2950	Maximum Contaminant Level Violation for TTHM	1/1/2008	7065
193	MAYFLOWER WATERWORKS	2950	Maximum Contaminant Level Violation for TTHM	4/1/2008	7065
193	MAYFLOWER WATERWORKS	2950	Maximum Contaminant Level Violation for TTHM	7/1/2008	7065
193	MAYFLOWER WATERWORKS	2950	Maximum Contaminant Level Violation for TTHM	10/1/2008	7065
438	MENA WATER DEPT	2456	Maximum Contaminant Level Violation for Total Haloacetic Acids (HAA5)	10/1/2008	5600

Thursday, June 25, 2009

Appendix G

Appendix G - Chemical Maximum Contaminant Level Violation

042	MOCKINGBIRD HILL WATER ASSOC	1025	Maximum Contaminant Level Violation for Fluoride	10/1/2008	693
951	MONTGOMERY CO REGIONAL PWA	2950	Maximum Contaminant Level Violation for TTHM	1/1/2008	0
951	MONTGOMERY CO REGIONAL PWA	2950	Maximum Contaminant Level Violation for TTHM	4/1/2008	0
951	MONTGOMERY CO REGIONAL PWA	2950	Maximum Contaminant Level Violation for TTHM	7/1/2008	0
951	MONTGOMERY CO REGIONAL PWA	2950	Maximum Contaminant Level Violation for TTHM	10/1/2008	0
951	MONTGOMERY CO REGIONAL PWA	2456	Maximum Contaminant Level Violation for Total Haloacetic Acids (HAA5)	10/1/2008	0
681	MORNING STAR WATER ASSOCIATION	1025	Maximum Contaminant Level Violation for Fluoride	1/1/2008	1325
681	MORNING STAR WATER ASSOCIATION	1025	Maximum Contaminant Level Violation for Fluoride	4/1/2008	1325
681	MORNING STAR WATER ASSOCIATION	1025	Maximum Contaminant Level Violation for Fluoride	4/1/2008	1325
681	MORNING STAR WATER ASSOCIATION	1025	Maximum Contaminant Level Violation for Fluoride	7/1/2008	1325
681	MORNING STAR WATER ASSOCIATION	1025	Maximum Contaminant Level Violation for Fluoride	10/1/2008	1325
392	MOUNT IDA WATERWORKS	2950	Maximum Contaminant Level Violation for TTHM	1/1/2008	2940
392	MOUNT IDA WATERWORKS	2950	Maximum Contaminant Level Violation for TTHM	4/1/2008	2940
392	MOUNT IDA WATERWORKS	2456	Maximum Contaminant Level Violation for Total Haloacetic Acids (HAA5)	7/1/2008	2940
392	MOUNT IDA WATERWORKS	2950	Maximum Contaminant Level Violation for TTHM	7/1/2008	2940

Thursday, June 25, 2009

Appendix G

Appendix G - Chemical Maximum Contaminant Level Violation

392	MOUNT IDA WATERWORKS	2950	Maximum Contaminant Level Violation for TTHM	10/1/2008	2940
136	MULBERRY WATERWORKS	2950	Maximum Contaminant Level Violation for TTHM	1/1/2008	1627
136	MULBERRY WATERWORKS	2950	Maximum Contaminant Level Violation for TTHM	4/1/2008	1627
136	MULBERRY WATERWORKS	2950	Maximum Contaminant Level Violation for TTHM	10/1/2008	1627
425	MURFREESBORO WATERWORKS	2950	Maximum Contaminant Level Violation for TTHM	1/1/2008	1800
867	N GARLAND CO REG WATER DIST	2950	Maximum Contaminant Level Violation for TTHM	4/1/2008	4406
867	N GARLAND CO REG WATER DIST	2950	Maximum Contaminant Level Violation for TTHM	7/1/2008	4406
867	N GARLAND CO REG WATER DIST	2950	Maximum Contaminant Level Violation for TTHM	10/1/2008	4406
805	NASHVILLE RURAL WATER ASSOC	2950	Maximum Contaminant Level Violation for TTHM	1/1/2008	5781
805	NASHVILLE RURAL WATER ASSOC	2950	Maximum Contaminant Level Violation for TTHM	4/1/2008	5781
805	NASHVILLE RURAL WATER ASSOC	2950	Maximum Contaminant Level Violation for TTHM	7/1/2008	5781
805	NASHVILLE RURAL WATER ASSOC	2950	Maximum Contaminant Level Violation for TTHM	10/1/2008	5781
244	NASHVILLE WATERWORKS	2950	Maximum Contaminant Level Violation for TTHM	7/1/2008	4878
244	NASHVILLE WATERWORKS	2950	Maximum Contaminant Level Violation for TTHM	10/1/2008	4878
697	NE YELL COUNTY WATER ASSOC	2950	Maximum Contaminant Level Violation for TTHM	1/1/2008	5705

Thursday, June 25, 2009

Appendix G

Appendix G - Chemical Maximum Contaminant Level Violation

697	NE YELL COUNTY WATER ASSOC	2456	Maximum Contaminant Level Violation for Total Haloacetic Acids (HAA5)	4/1/2008	5705
557	NEW LONDON WATER ASSOCIATION	2950	Maximum Contaminant Level Violation for TTHM	1/1/2008	880
557	NEW LONDON WATER ASSOCIATION	2950	Maximum Contaminant Level Violation for TTHM	4/1/2008	880
557	NEW LONDON WATER ASSOCIATION	2950	Maximum Contaminant Level Violation for TTHM	7/1/2008	880
557	NEW LONDON WATER ASSOCIATION	2950	Maximum Contaminant Level Violation for TTHM	10/1/2008	880
826	NORTH PIKE CO RURAL WATER ASSN	2950	Maximum Contaminant Level Violation for TTHM	1/1/2008	1945
616	ODEN- PENCIL BLUFF WATER ASSN.	2950	Maximum Contaminant Level Violation for TTHM	1/1/2008	343
616	ODEN- PENCIL BLUFF WATER ASSN.	2950	Maximum Contaminant Level Violation for TTHM	4/1/2008	343
616	ODEN- PENCIL BLUFF WATER ASSN.	2950	Maximum Contaminant Level Violation for TTHM	7/1/2008	343
616	ODEN- PENCIL BLUFF WATER ASSN.	2950	Maximum Contaminant Level Violation for TTHM	10/1/2008	343
604	OLA WATERWORKS	2950	Maximum Contaminant Level Violation for TTHM	1/1/2008	1204
580	PANGBURN WATERWORKS	2456	Maximum Contaminant Level Violation for Total Haloacetic Acids (HAA5)	1/1/2008	2464
580	PANGBURN WATERWORKS	2456	Maximum Contaminant Level Violation for Total Haloacetic Acids (HAA5)	4/1/2008	2464
580	PANGBURN WATERWORKS	2456	Maximum Contaminant Level Violation for Total Haloacetic Acids (HAA5)	10/1/2008	2464
883	PARON-OWENSVILLE WATER AUTH	2950	Maximum Contaminant Level Violation for TTHM	1/1/2008	1825

Thursday, June 25, 2009

Appendix G

Appendix G - Chemical Maximum Contaminant Level Violation

883	PARON-OWENSVILLE WATER AUTH	2950	Maximum Contaminant Level Violation for TTHM	4/1/2008	1825
883	PARON-OWENSVILLE WATER AUTH	2950	Maximum Contaminant Level Violation for TTHM	7/1/2008	1825
883	PARON-OWENSVILLE WATER AUTH	2950	Maximum Contaminant Level Violation for TTHM	9/1/2008	1825
883	PARON-OWENSVILLE WATER AUTH	2950	Maximum Contaminant Level Violation for TTHM	10/1/2008	1825
413	PERRYVILLE WATERWORKS	2950	Maximum Contaminant Level Violation for TTHM	7/1/2008	2112
413	PERRYVILLE WATERWORKS	2950	Maximum Contaminant Level Violation for TTHM	10/1/2008	2112
818	PIKE CITY WATER ASSN	2950	Maximum Contaminant Level Violation for TTHM	1/1/2008	300
818	PIKE CITY WATER ASSN	2950	Maximum Contaminant Level Violation for TTHM	4/1/2008	300
818	PIKE CITY WATER ASSN	2950	Maximum Contaminant Level Violation for TTHM	7/1/2008	300
818	PIKE CITY WATER ASSN	2950	Maximum Contaminant Level Violation for TTHM	10/1/2008	300
605	PLAINVIEW WATER DEPARTMENT	2950	Maximum Contaminant Level Violation for TTHM	1/1/2008	1083
605	PLAINVIEW WATER DEPARTMENT	2456	Maximum Contaminant Level Violation for Total Haloacetic Acids (HAA5)	4/1/2008	1083
018	PORTLAND WATERWORKS	2950	Maximum Contaminant Level Violation for TTHM	1/1/2008	737
394	PRESCOTT WATERWORKS	2950	Maximum Contaminant Level Violation for TTHM	1/1/2008	4275
329	RATCLIFF WATERWORKS	2950	Maximum Contaminant Level Violation for TTHM	1/1/2008	1305

Thursday, June 25, 2009

Appendix G

Appendix G - Chemical Maximum Contaminant Level Violation

329	RATCLIFF WATERWORKS	2950	Maximum Contaminant Level Violation for TTHM	4/1/2008	1305
329	RATCLIFF WATERWORKS	2950	Maximum Contaminant Level Violation for TTHM	7/1/2008	1305
329	RATCLIFF WATERWORKS	2950	Maximum Contaminant Level Violation for TTHM	10/1/2008	1305
330	SCRANTON WATERWORKS	2456	Maximum Contaminant Level Violation for Total Haloacetic Acids (HAA5)	7/1/2008	1258
330	SCRANTON WATERWORKS	2456	Maximum Contaminant Level Violation for Total Haloacetic Acids (HAA5)	10/1/2008	1258
758	SDM WATER ASSOCIATION	1025	Maximum Contaminant Level Violation for Fluoride	1/1/2008	373
758	SDM WATER ASSOCIATION	1025	Maximum Contaminant Level Violation for Fluoride	4/1/2008	373
758	SDM WATER ASSOCIATION	1025	Maximum Contaminant Level Violation for Fluoride	7/1/2008	373
758	SDM WATER ASSOCIATION	1025	Maximum Contaminant Level Violation for Fluoride	10/1/2008	373
868	SEVIER CO WATER ASSOCIATION	2950	Maximum Contaminant Level Violation for TTHM	1/1/2008	4185
868	SEVIER CO WATER ASSOCIATION	2456	Maximum Contaminant Level Violation for Total Haloacetic Acids (HAA5)	4/1/2008	4185
851	SOUTH LOGAN COUNTY WATER	2950	Maximum Contaminant Level Violation for TTHM	1/1/2008	1420
851	SOUTH LOGAN COUNTY WATER	2950	Maximum Contaminant Level Violation for TTHM	4/1/2008	1420
851	SOUTH LOGAN COUNTY WATER	2950	Maximum Contaminant Level Violation for TTHM	7/1/2008	1420
851	SOUTH LOGAN COUNTY WATER	2950	Maximum Contaminant Level Violation for TTHM	10/1/2008	1420

Thursday, June 25, 2009

Appendix G

Appendix G - Chemical Maximum Contaminant Level Violation

166	SPARKMAN WATERWORKS	2950	Maximum Contaminant Level Violation for TTHM	1/1/2008	700
334	SUBIACO ACADEMY WATERWORKS	2456	Maximum Contaminant Level Violation for Total Haloacetic Acids (HAA5)	1/1/2008	250
334	SUBIACO ACADEMY WATERWORKS	2950	Maximum Contaminant Level Violation for TTHM	1/1/2008	250
334	SUBIACO ACADEMY WATERWORKS	2950	Maximum Contaminant Level Violation for TTHM	4/1/2008	250
334	SUBIACO ACADEMY WATERWORKS	2456	Maximum Contaminant Level Violation for Total Haloacetic Acids (HAA5)	4/1/2008	250
334	SUBIACO ACADEMY WATERWORKS	2456	Maximum Contaminant Level Violation for Total Haloacetic Acids (HAA5)	7/1/2008	250
334	SUBIACO ACADEMY WATERWORKS	2950	Maximum Contaminant Level Violation for TTHM	7/1/2008	250
334	SUBIACO ACADEMY WATERWORKS	2456	Maximum Contaminant Level Violation for Total Haloacetic Acids (HAA5)	10/1/2008	250
334	SUBIACO ACADEMY WATERWORKS	2950	Maximum Contaminant Level Violation for TTHM	10/1/2008	250
360	TEXARKANA WATER UTILITIES	2950	Maximum Contaminant Level Violation for TTHM	4/1/2008	28775
798	TOAD SUCK PUBLIC FACILITY BD	2950	Maximum Contaminant Level Violation for TTHM	7/1/2008	1100
798	TOAD SUCK PUBLIC FACILITY BD	2456	Maximum Contaminant Level Violation for Total Haloacetic Acids (HAA5)	10/1/2008	1100
498	WALDRON WATERWORKS	2950	Maximum Contaminant Level Violation for TTHM	1/1/2008	4400
498	WALDRON WATERWORKS	2950	Maximum Contaminant Level Violation for TTHM	4/1/2008	4400
498	WALDRON WATERWORKS	2456	Maximum Contaminant Level Violation for Total Haloacetic Acids (HAA5)	4/1/2008	4400

Thursday, June 25, 2009

Appendix G

Appendix G - Chemical Maximum Contaminant Level Violation

498	WALDRON WATERWORKS	2456	Maximum Contaminant Level Violation for Total Haloacetic Acids (HAA5)	7/1/2008	4400
498	WALDRON WATERWORKS	2950	Maximum Contaminant Level Violation for TTHM	7/1/2008	4400
498	WALDRON WATERWORKS	2950	Maximum Contaminant Level Violation for TTHM	10/1/2008	4400
783	WIRE ROAD WATER SYSTEM	2950	Maximum Contaminant Level Violation for TTHM	1/1/2008	769
783	WIRE ROAD WATER SYSTEM	2456	Maximum Contaminant Level Violation for Total Haloacetic Acids (HAA5)	1/1/2008	769
196	WOOSTER WATERWORKS	2950	Maximum Contaminant Level Violation for TTHM	1/1/2008	3450
196	WOOSTER WATERWORKS	2950	Maximum Contaminant Level Violation for TTHM	4/1/2008	3450
196	WOOSTER WATERWORKS	2950	Maximum Contaminant Level Violation for TTHM	7/1/2008	3450
410	WYE MOUNTAIN WATER ASSOCIATION	2950	Maximum Contaminant Level Violation for TTHM	4/1/2008	1330
410	WYE MOUNTAIN WATER ASSOCIATION	2950	Maximum Contaminant Level Violation for TTHM	7/1/2008	1330
410	WYE MOUNTAIN WATER ASSOCIATION	2950	Maximum Contaminant Level Violation for TTHM	10/1/2008	1330

PWS type: N

PWS ID	System Name	SDWIS Code	Violation Definition	Violation Date	Retail population
T0719	USCOE OC - SPILLWAY	0400	Maximum Contaminant Level Violation for DBP Stage 1	6/1/2008	100

PWS type: P

PWS ID	System Name	SDWIS Code	Violation Definition	Violation Date	Retail population
T1110	ARK STATE PARK MT MAGAZINE	2950	Maximum Contaminant Level Violation for TTHM	1/1/2008	28

Thursday, June 25, 2009

Appendix G

Appendix G - Chemical Maximum Contaminant Level Violation

T1110	ARK STATE PARK MT MAGAZINE	2950	Maximum Contaminant Level Violation for TTHM	4/1/2008	28
T1110	ARK STATE PARK MT MAGAZINE	2950	Maximum Contaminant Level Violation for TTHM	7/1/2008	28
T1110	ARK STATE PARK MT MAGAZINE	2950	Maximum Contaminant Level Violation for TTHM	10/1/2008	28
N0020	EL DORADO CHEMICAL COMPANY	2950	Maximum Contaminant Level Violation for TTHM	1/1/2008	150
N0020	EL DORADO CHEMICAL COMPANY	2950	Maximum Contaminant Level Violation for TTHM	4/1/2008	150
N0188	NW ARKANSAS REGIONAL AIRPORT	2950	Maximum Contaminant Level Violation for TTHM	10/1/2008	55

Appendix H - Radium Maximum Contaminant Level Violation

PWS type: C

PWS ID2	System Name	SDWIS Code	Violation Date	Retail population
680	MT SHERMAN WATER ASSOCIATION	4010	1/1/2008	732
680	MT SHERMAN WATER ASSOCIATION	4010	4/1/2008	732
680	MT SHERMAN WATER ASSOCIATION	4010	7/1/2008	732
680	MT SHERMAN WATER ASSOCIATION	4010	10/1/2008	732
758	SDM WATER ASSOCIATION	4010	1/1/2008	373
758	SDM WATER ASSOCIATION	4010	4/1/2008	373
758	SDM WATER ASSOCIATION	4010	7/1/2008	373
758	SDM WATER ASSOCIATION	4010	10/1/2008	373
815	SOUTH MOUNTAIN WATER ASSN	4010	1/1/2008	636
815	SOUTH MOUNTAIN WATER ASSN	4010	4/1/2008	636
815	SOUTH MOUNTAIN WATER ASSN	4010	7/1/2008	636
815	SOUTH MOUNTAIN WATER ASSN	4010	10/1/2008	636

Thursday, June 25, 2009

Appendix H

Appendix I - Lead & Copper Rule Monitoring & Treatment Technique Violations

PWS type: C

PWS ID	System Name	SDWIS Code	Violation Definition	Violation Date	Retail population
648	ALLPORT WATER WORKS	52	Follow-up and Routine Tap Sampling	1/1/2008	280
377	BASSETT WATERWORKS	52	Follow-up and Routine Tap Sampling	1/1/2008	227
344	HUMNOKE WATERWORKS	52	Follow-up and Routine Tap Sampling	1/1/2008	281
344	HUMNOKE WATERWORKS	52	Follow-up and Routine Tap Sampling	7/1/2008	281
703	MT ZION WATER ASSOCIATION	52	Follow-up and Routine Tap Sampling	1/1/2008	202
806	WIEDERKEHR VILLAGE WATER DEPT	52	Follow-up and Routine Tap Sampling	7/1/2008	70

Appendix J - No Violations For This Calendar Year

PWS ID	System Name	Retail population served
PWS type:PWS type: C		
315	ADC - CUMMINS UNIT MAINT	3800
282	ADC - TUCKER UNIT MAINT	1500
796	ADC EAST ARKANSAS REGIONAL	1624
663	AIRPORT ROAD WATER ASSOCIATION	619
058	ALPENA WATERWORKS	530
271	ALTHEIMER WATERWORKS	1166
197	ALTUS WATERWORKS	1778
424	ANTOINE WATERWORKS	548
790	AR DEPT OF CORRECTION IZARD CO	600
085	ARKADELPHIA WATERWORKS	10300
167	ARKANSAS CITY WATERWORKS	609
667	ARSENAL WATER SYSTEM	2577
527	ASH FLAT WATER COMPANY	1097
320	ASHDOWN WATERWORKS	4538
597	AUGUSTA WATERWORKS	2665
346	AUSTIN WATERWORKS	1105
890	AUTUMN ACRES MHP	88
689	BALD KNOB NORTH WATER ASSOC	2628
584	BALD KNOB WATERWORKS	3210
068	BANKS WATERWORKS	294
785	BARKADA WATER ASSOCIATION	381
512	BARLING WATERWORKS	4250
415	BARTON LEXA WATER ASSOCIATION	3929
819	BASIN VALLEY WATER SYSTEM	390
250	BATESVILLE WATER UTILITIES	11672
622	BATTS-LAPILE WATER ASSOCIATION	603
497	BAUXITE WATER	488
129	BAY WATERWORKS	1735
401	BEARDEN WATERWORKS	2119
038	BEAVER WATER DISTRICT	0
904	BEDFORD FALLS MHP	90
462	BEE BRANCH WATER	3000
592	BEEBE WATERWORKS	4950
262	BEEDEVILLE WATER WORKS	116
059	BELLEFONTE WATER	445
600	BELLEVILLE WATER	925
037	BENTON CO WATER	4420
899	BENTON COUNTY WATER AUTHORITY4	520
484	BENTON WATERWORKS	18100

Thursday, June 25, 2009

Appendix J

Appendix J - No Violations For This Calendar Year

PWS ID	System Name	Retail population served
060	BERGMAN WATERWORKS	1834
074	BERRYVILLE WATERWORKS	5152
543	BEULAH GROVE WATER	102
799	BIG CLIFTY WATER	114
1042	BIG POND WATER ASSOCIATION	35
411	BIGELOW WATERWORKS	544
417	BIRDSONG WHITTON WATER ASSOC	483
448	BISCOE WATERWORKS	480
302	BLACK ROCK WATERWORKS	797
233	BLEVINS WATERWORKS	413
638	BLUE MOUNTAIN WATERWORKS	338
365	BLYTHEVILLE WATERWORKS	18722
178	BOIS D'ARC WATER SYSTEM	128
979	Bonanza Waterworks	625
126	BONO WATERWORKS	1971
336	BOONEVILLE DEVELOPMENT CENTER	275
179	BOWSER WATER ASSN	538
014	BOYDELL WATER ASSOCIATION	148
294	BRADLEY WATERWORKS	482
223	BRECKENRIDGE UNION WATER ASSOC	1404
024	BRIARCLIFF WATERWORKS	248
384	BRINKLEY WATERWORKS	4485
131	BROOKLAND WATERWORKS	1858
837	BRUNNER HILL WATER ASSOC	973
295	BUCKNER WATERWORKS	355
671	BUFFALO ISLAND REG WATER DIST	2710
352	BULL SHOALS WATER SYSTEM	2362
366	BURDETTE WATERWORKS	586
338	CABOT WATERWORKS	19621
532	CALDWELL WATER	1280
003	CALICO ROCK WATERWORKS	1766
877	CAMP ROBINSON	1000
261	CAMPBELL STATION WATERWORKS	240
127	CARAWAY WATERWORKS	1230
325	CARBON CITY WATER	150
339	CARLISLE WATERWORKS	2304
675	CARROLL-BOONE WATER DISTRICT	0
165	CARTHAGE WATER AND SEWER	335
526	CAVE CITY WATERWORKS	2527
043	CAVE SPRINGS WATERWORKS	1344

Thursday, June 25, 2009

Appendix J

Appendix J - No Violations For This Calendar Year

PWS ID	System Name	Retail population served
138	CEDARVILLE WATERWORKS	7703
213	CENTER GROVE WATER ASSOCIATION	4284
044	CENTERTON WATERWORKS	10062
465	CENTRAL ARKANSAS WATER	323212
845	CENTRAL LOGAN COUNTY PWF	1180
503	CENTRAL WATER USERS ASSOC	1218
901	CHAMBERLYNE COUNTRY CLUB	142
200	CHARLESTON WATERWORKS	3390
521	CHEROKEE VILLAGE WATER ASSOC	6900
158	CHERRY VALLEY WATERWORKS	742
647	CHESTER WATER WORKS	240
661	CHICOT JUNCTION WATER ASSOC	802
403	CHIDESTER WATER WORKS	466
446	CITY CORPORATION	28973
385	CLARENDON WATERWORKS	2070
741	CLARK CO COUNTRY WATER FACILIT	2275
148	CLARKDALE-JERICO WATER ASSOC	927
289	CLARKSVILLE WATERWORKS	9073
722	CLAY CO REG WATER DISTRICT	5704
069	CLEVELAND CO WATER ASSOC	1698
290	COAL HILL WATERWORKS	1455
181	COLLINS WATER ASSOCIATION	241
533	COLT WATER ASSOCIATION	1158
147	CONCORD WATER & SEWER PFB	3000
119	CONWAY CO REGIONAL WATER DIST	19685
927	CORINTH VALLEY WATER SYSTEM	103
096	CORNING WATERWORKS	3554
028	COTTER WATERWORKS	1034
620	COTTONSHED WATERWORKS	55
813	COTTONWOOD WATER ASSOCIATION	450
439	COVE WATERWORKS	688
340	COY WATERWORKS	350
748	CRABAPPLE POINT WATER SYSTEM	10
149	CRAWFORDSVILLE WATERWORKS	2608
873	CRESTWOOD MOBILE HOME PARK	34
017	CROSSETT WATER COMMISSION	7523
180	CROWLEYS RIDGE WATER ASSOC	3868
249	CUSHMAN WATER SYSTEM	1295
190	DAMASCUS WATER WORKS	1770
052	DECATUR WATERWORKS	1589

Thursday, June 25, 2009

Appendix J

Appendix J - No Violations For This Calendar Year

PWS ID	System Name	Retail population served
685	DEER RUN WATER COMPANY	105
224	DELAPLAINE WATERWORKS	157
423	DELIGHT WATERWORKS	1375
367	DELL WATERWORKS	1334
461	DENNARD WATER ASSOCIATION	608
520	DEQUEEN WATER WORK	5723
082	DERMOTT WATERWORKS	3421
449	DES ARC WATERWORKS	3882
450	DEVALLS BLUFF WATERWORKS	783
061	DIAMOND CITY WATER	1390
269	DIAZ WATERWORKS	1092
243	DIERKS WATER WORKS	1695
585	DOGWOOD WATER ASSOCIATION	1456
139	DORA WATER ASSOCIATION	265
714	DORCHEAT WATER ASSOCIATION	2183
698	Dota Public Water Authority	2455
444	DOVER WATERWORKS	1764
369	DRIVER GRIDER WATER ASSOC	264
171	DUMAS WATERWORKS	5875
730	DYESS RURAL WATER	330
376	DYESS WATERWORKS	430
886	E CASS WATER SUPPLY CORP	140
150	EARLE WATERWORKS	2785
646	EAST END WATER	5266
772	EAST JOHNSON CO WATER ASSN	3450
879	EAST LAKE WATER USERS ASSN	43
715	EAST MONROE COUNTY WATER USERS	966
539	EASTSIDE HOMEOWNERS ASSOC	175
350	EDGEWOOD BAY WATER	277
418	ELAINE WATERWORKS	1939
567	ELKINS WATERWORKS	2480
111	EMERSON WATERWORKS	1205
393	EMMET WATERWORKS	620
341	ENGLAND WATERWORKS	3170
183	ENON WATER ASSOCIATION	482
083	EUDORA WATERWORKS	3158
525	EVENING SHADE WATERWORKS	788
544	FAIRCREST WATER ASSOCIATION	994
569	FAYETTEVILLE WATERWORKS	82349
514	FCMTC WATERWORKS	89

Thursday, June 25, 2009

Appendix J

Appendix J - No Violations For This Calendar Year

PWS ID	System Name	Retail population served
545	FELSENTHAL WATER ASSOCIATION	660
351	FLIPPIN WATERWORKS	3473
635	FORDYCE RURAL WATER ASSOC	1486
164	FORDYCE WATER CO	4748
323	FOREMAN WATERWORKS	1383
507	FORT SMITH WATER UTILITIES	80258
358	FOUKE WATERWORKS	1033
586	FOUR MILE HILL WATER ASSOC	4048
257	FRANKLIN WATERWORKS	265
625	FREE HOPE WATER ASSOCIATION	180
814	FULTON COUNTY WATER ASSOC	1781
231	FULTON WATERWORKS	425
645	FURLOW WATER ASSOCIATION	2925
047	GARFIELD WATERWORKS	692
357	GARLAND WATERWORKS	450
692	GARRETT BRIDGE WATER ASSOC	871
693	GATEWAY PUBLIC WATER AUTHORITY	1966
048	GENTRY WATERWORKS	5598
699	GENTRYVILLE PUBLIC WATER AUTH	358
009	GILLETT WATER DEPT	816
516	GILLHAM WATERWORKS	300
154	GILMORE WATERWORKS	292
857	GLEN ACRES	59
374	GOSNELL WATER ASSOCIATION	3612
734	GRAND PRAIRIE BAYOU 2 P.F.B.	9630
759	GRANGE-CALAMINE WATER ASSOC	2102
437	GRANNIS WATERWORKS	498
051	GRAVETTE WATERWORKS	3264
076	GRAY ROCK WATER ASSOCIATION	670
696	GREASY VALLEY WATER ASSOC	270
077	GREEN FOREST WATERWORKS	5416
701	GREEN HILL-BROOKS CHAPEL WATER	701
267	GRUBBS WATERWORKS	907
086	GUM SPRINGS WATER ASSOCIATION	1023
087	GURDON WATERWORKS	3403
192	GUY WATERWORKS	1776
505	HACKETT WATERWORKS	860
015	HAMBURG WATERWORKS	3014
273	HARDIN WATER ASSOCIATION	4916
524	HARDY WATERWORKS	923

Thursday, June 25, 2009

Appendix J

Appendix J - No Violations For This Calendar Year

PWS ID	System Name	Retail population served
402	HARMONY GROVE WATER ASSOC	2237
546	HARMONY WATER ASSOCIATION	357
071	HARRELL WATERWORKS	391
431	HARRISBURG WATERWORKS	2192
506	HARTFORD WATERWORKS	785
286	HARTMAN WATERWORKS	975
488	HASKELL WATER SYSTEM	2950
602	HAVANA WATERWORKS	1188
452	HAZEN WATERWORKS	1668
427	HEAFER-BLACK OAK WATER ASSOC	494
104	HEBER SPRINGS WATER SYSTEM	11818
419	HELENA WATER SEWER	6200
067	HERMITAGE WATERWORKS	612
672	Highland Public Water Authority	2376
078	HOLIDAY ISLAND WATERWORKS	3480
388	HOLLY GROVE WATERWORKS	1964
230	HOPE WATER LIGHT COMM	11405
518	HORATIO WATERWORKS	1145
617	HORSEHEAD WATER ASSOCIATION	4282
236	HOT SPRING CO WATER ASSOC	3375
208	HOT SPRINGS VILLAGE WATERWORKS	16952
209	HOT SPRINGS WATERWORKS	68780
414	HOUSTON WATERWORKS	611
301	HOXIE WATER DEPARTMENT	2817
011	HUGHES COMMUNITY WATER ASSOC	2483
531	HUGHES WATERWORKS	1867
508	HUNTINGTON WATERWORKS	713
348	HUNTSVILLE WATERWORKS	3033
553	HUTTIG WATERWORKS	920
107	HWY 63 WATER ASSOCIATION	7470
749	HWY 64 WATER ASSOCIATION	231
145	HWY 71 WATER DISTRICT #1 PWA	5958
702	HWY 9 WATER ASSOCIATION	1188
300	IMBODEN WATERWORKS	704
263	JACKSONPORT WATERWORKS	305
466	JACKSONVILLE WATERWORKS	16878
513	JAMES FORK REGIONAL WATER DISTRICT	9958
276	JEFFERSON-SAMPLES-DEXTER WATER	2642
372	JOINER WATERWORKS	777
124	JONESBORO WATER SYSTEM	67995

Thursday, June 25, 2009

Appendix J

Appendix J - No Violations For This Calendar Year

PWS ID	System Name	Retail population served
582	JUDSONIA WATERWORKS	3082
168	KELSO-ROHWER WATER ASSOCIATION	537
588	KENSETT WATERWORKS	1667
337	KEO WATER WORKS	423
140	KIBLER WATER SYSTEM	1750
827	KINGS HILL ESTATES	25
108	KINGSLAND WATERWORKS	645
099	KNOBEL WATERWORKS	315
287	KNOXVILLE WATERWORKS	1800
706	KROOKED KREEK WATER ASSN	1725
684	LACEY-LADELLE WATER ASSOCIATIO	1370
277	LADD WATER ASSOCIATION	2800
483	LAFE RURAL WATER ASSOCIATION	2378
031	LAKE BULL SHOALS ESTATES WATER	54
080	LAKE CHICOT WATER ASSOCIATION	1687
677	LAKE FOREST SUBORDINATE DIST	91
780	LAKE LUCERNE ESTATES	55
081	LAKE VILLAGE WATERWORKS	2870
726	LAKESHORE ESTATES WATER ASSN	1012
822	LAKESIDE WATER ASSOCIATION	1598
027	LAKEVIEW-MIDWAY WATER ASSOC	3564
288	LAMAR WATERWORKS	1666
510	LAVACA WATERWORKS	3148
688	LAWRENCE CO REG WATER DIST	6180
548	LAWSON-URBANA WATER ASSOC	1140
063	LEAD HILL WATERWORKS	482
218	LEOLA WATERWORKS	720
432	LEPANTO WATERWORKS	2329
500	LESLIE WATER SYSTEM	660
572	LINCOLN WATERWORKS	4284
716	LISBON WATER ASSOCIATION	399
214	LITTLE CREEK WATER ASSOCIATION	2100
808	LITTLE PORTION HERMITAGE	30
787	LITTLE RIVER CO RDA	4250
467	LITTLE RIVER COUNTRY CLUB	400
371	LITTLE RIVER WATER ASSOCIATION	866
912	LOCKE-FERN DOLLARD RD WW PFB	1195
102	LOCUST BAYOU WATER ASSOCIATION	484
443	LONDON WATERWORKS	1250
274	LONG LAKE WATER ASSOCIATION	500

Thursday, June 25, 2009

Appendix J

Appendix J - No Violations For This Calendar Year

PWS ID	System Name	Retail population served
343	LONOKE WATERWORKS	4400
049	LOST BRIDGE VILL WAT-SEW DIST	916
406	LOUANN WATERWORKS	221
292	LUDWIG WATER ASSOCIATION	1265
718	LURTON-PELSOR WATER ASSOC	289
361	LUXORA WATERWORKS	1027
713	LYDESDALE WATER ASSOCIATION	390
803	MADISON CO REGIONAL WATER	0
246	MAGNESS WATER ASSOCIATION	420
241	MAGNET-BUTTERFIELD WATER ASSOC	1763
206	MAMMOTH SPRING WATERWORKS	1487
378	MANILA WATERWORKS	3348
509	MANSFIELD WATERWORKS	2283
310	MARIANNA WATERWORKS	5180
770	MARION COUNTY REG WATER DIST	2
430	MARKED TREE WATERWORKS	2528
225	MARMADUKE WATERWORKS	940
501	MARSHALL WATERWORKS	2380
421	MARVELL WATERWORKS	1374
001	MARYSVILLE WATER ASSOCIATION	744
464	MAUMELLE WATER CORPORATION	2201
463	MAUMELLE WATER MANAGEMENT	15600
619	MAYNARD WATERWORKS	468
599	MC CRORY WATERWORKS	1850
098	MC DOUGAL WATERWORKS	306
170	MC GEHEE WATERWORKS	4839
705	MC NEIL RURAL WATER ASSOC	868
110	MC NEIL WATERWORKS	660
589	MC RAE WATERWORKS	685
256	MELBOURNE WATERWORKS	4203
153	MIDWAY WATER ASSOCIATION	2600
786	MILL POND VILLAGE MHP	146
773	MILLTOWN-WASHBURN WATER USERS	3300
169	MITCHELLVILLE WATERWORKS	475
128	MONETTE WATERWORKS	1352
314	MORO WATERWORKS	241
709	MORRISON BLUFF WATER SYSTEM	320
002	MOUNT HOLLY WATERWORKS	407
668	MOUNT OLIVE WATER ASSOCIATION	5430
176	MOUNTAIN PINE WATERWORKS	778

Thursday, June 25, 2009

Appendix J

Appendix J - No Violations For This Calendar Year

PWS ID	System Name	Retail population served
454	MOUNTAIN TOP WATER ASSOCIATION	6605
542	MOUNTAIN VIEW WATERWORKS	6867
141	MOUNTAINBURG WATER AND SEWER	693
258	MT PLEASANT WATERWORKS	1256
633	MUNDELL HEIGHTS WATERWORKS	148
1069	N E WHITE COUNTY PUBLIC FACILITIES BOARD	
856	NAIL-SWAIN WATER ASSOCIATION	550
673	NE MISSISSIPPI CO WATER ASSOC	1122
683	NEW HOPE WATER ASSOCIATION	1163
248	NEWARK WATERWORKS	1512
264	NEWPORT WATERWORKS	7811
035	NORFORK WATERWORKS	971
581	NORFORK WATERWORKS-NORFORK VIL	80
554	NORPHLET WATERWORKS	1148
022	NORTH CROSSETT UTILITIES	3167
023	NORTH EAST CROSSETT WATER ASSN	171
033	NORTH EAST PUBLIC WATER AUTH	3540
012	NORTH LAGRUE WATER ASSOC	282
725	NORTH PULASKI PFB	8665
583	NORTH WHITE CO RURAL WATER PFB	4900
007	NORTHEAST DEWITT WATER ASSOC	631
659	NORTHERN HILLS MH COMMUNITY	458
763	NORTHERN MALVERN WATER ASSN	1150
175	NORTHERN OHIO WATER ASSOC	706
881	OAK GLEN MOBILE HOME COMMUNITY	219
801	OAK GROVE WATER	490
146	OAK GROVE WATER ASSOCIATION	2670
558	OAK MANOR WATER ASSOCIATION	335
745	OAKWOOD MHP WATERWORKS	35
322	OGDEN WATERWORKS	495
247	OIL TROUGH WATERWORKS	284
473	O'KEAN WATERWORKS	219
089	OKOLONA WATERWORKS	613
753	OLD BELLA VISTA POA	120
559	OLD UNION WATER ASSOCIATION	1205
120	OPPELO WATER DEPARTMENT	1252
375	OSCEOLA WATERWORKS	8875
259	OXFORD WATERWORKS	1062
227	OZAN WATERWORKS	378
530	OZARK ACRES WATER ASSOCIATION	889

Thursday, June 25, 2009

Appendix J

Appendix J - No Violations For This Calendar Year

PWS ID	System Name	Retail population served
201	OZARK WATERWORKS	3730
536	PALESTINE WATER ASSOCIATION	1988
222	PARAGOULD CITY LIGHT WATER	22744
019	PARKDALE WATERWORKS	324
560	PARKERS CHAPEL PUBLIC WATER	2306
662	PARKIN RURAL WATER ASSOCIATION	462
160	PARKIN WATERWORKS	1602
736	PARTHENON WATER ASSOCIATION	344
053	PEA RIDGE WATERWORKS	5618
649	PENDLETON-PEA RIDGE WATER ASSN	946
234	PERRYTOWN WATERWORKS	118
251	PFEIFFER WATER AUTHORITY	3251
172	PICKENS WATERWORKS	188
090	PIGGOTT WATERWORKS	4975
113	PINE REST MOBILE HOME PARK	68
720	PLEASANT GROVE	2202
202	PLEASANT VIEW WATER FAC BOARD	1663
121	PLUMERVILLE WATERWORKS	1054
474	POCAHONTAS WATERWORKS	6798
092	POLLARD WATERWORKS	364
305	PORTIA WATERWORKS	576
217	POYEN WATERWORKS	848
573	PRAIRIE GROVE WATERWORKS	4715
216	PRATTSVILLE WATERWORKS	1282
561	QUINN WATER ASSOCIATION	728
040	RAMBO RIVIERA SD WATERWORKS	83
477	RAVENDEN SPRINGS WATERWORKS	163
306	RAVENDEN WATERWORKS	564
279	REDFIELD WATERWORKS	2652
732	REDHILL WATER ASSOCIATION	463
173	REED WATERWORKS	252
475	REYNO WATERWORKS	517
835	RICHWOOD WATER ASSOCIATION	1358
106	RISON WATERWORKS	1443
833	RIVER VALLEY WATER ASSN	421
674	RIVERSOUTH RURAL WATER DIST	3910
239	RIVIERA UTILITIES	1543
389	ROE WATERWORKS	124
055	ROGERS WATER UTILITIES	54803
395	ROSSTON WATER DEPARTMENT	630

Thursday, June 25, 2009

Appendix J

Appendix J - No Violations For This Calendar Year

PWS ID	System Name	Retail population served
591	RUSSELL WATERWORKS	250
875	RUSSELLVILLE- RWPSID2INC	145
678	S P G WATER ASSOCIATION	1374
492	SALEM WATER ASSOCIATION	11475
204	SALEM WATERWORKS	1851
036	SALESVILLE WATERWORKS	575
491	SALINE CO WW SS PFB	1539
379	SANDRIDGE-BARDSTOWN WTR ASSOC	153
493	SARDIS WATER ASSOCIATION	12482
594	SE WHITE COUNTY WATER ASSOC	4803
511	SEBASTIAN LAKE PUBLIC WATER AUTHORITY	243
182	SELMA WATER ASSOCIATION	986
540	SHADY ACRES MOBILE HOME PARK	58
800	SHANNON HILLS WATER DEPT	2885
215	SHERIDAN WATERWORKS	3750
565	SHIRLEY WATERWORKS	400
407	SHUMAKER PUBLIC SERVICE CO	870
056	SILOAM SPRINGS WATERWORKS	15088
555	SMACKOVER WATERWORKS	3019
219	SOUTH SHERIDAN WATER ASSOC	2945
792	SOUTHERN HILLS WATER SYSTEM	45
254	SOUTHSIDE PUB WATER AUTHORITY	8000
757	SOUTHWEST ATKINS WATER USERS	1170
495	SOUTHWEST WATER ASSOCIATION	6317
293	SPADRA-GOOSE CAMP WATER ASSOC	500
005	ST CHARLES WATERWORKS	415
537	ST FRANCIS RURAL WATER ASSOC	1212
094	ST FRANCIS WATER SYSTEM	252
347	ST PAUL WATERWORKS	178
296	STAMPS WATERWORKS	2952
318	STAR CITY WATER COMPANY	2790
755	STARLIGHT ESTATES	42
405	STEPHENS WATERWORKS	1426
013	STUTTGART WATERWORKS	9745
135	SUBIACO CITY WATERWORKS	483
095	SUCCESS WATERWORKS	266
472	SUNSET WATER ASSOCIATION	880
628	SW BOONE COUNTY WATER ASSOC	3687
852	SW WARREN WATER ASSOCIATION	720
185	SW WHITE COUNTY WATER ASSN	9108

Thursday, June 25, 2009

Appendix J

Appendix J - No Violations For This Calendar Year

PWS ID	System Name	Retail population served
265	SWIFTON WATERWORKS	994
882	SYLAMORE VALLEY WATER ASSN	278
045	SYLVAN SHORES SD WATERWORKS	74
891	TALL OAKS MHP	37
114	TAYLOR WATERWORKS	663
072	THORNTON WATERWORKS	838
186	TILLAR WATERWORKS	357
618	TOLLETTE WATER	338
846	TRI COUNTY RWDD -MOORES CHAPEL	1008
782	TRI-COUNTY WATER DISTBR DIST	16500
825	TULIP - PRINCETON WATER ASSN	1131
220	TULL WATER	1756
579	TUMBLING SHOALS WATER ASSOC	5030
155	TURRELL WATER WORKS	954
426	TYRONZA WATERWORKS	932
451	ULM WATERWORKS	206
272	UNITED WATER ARKANSAS	40023
654	UNITED WATER ASSOCIATION	568
690	US AIR FORCE BASE LITTLE ROCK	7288
065	VALLEY SPRINGS WATERWORKS	2950
727	VAN BUREN COUNTY W U A	2975
162	VANNDALE-BIRDEYE WATER ASSOC	2312
380	VICTORIA WATER ASSOCIATION	39
115	VILLAGE WATER ASSOCIATION	463
195	VILONIA WATERWORKS	19550
205	VIOLA WATERWORKS	354
460	WALDENBURG WATER ASSOCIATION	215
112	WALDO WATERWORKS	1938
858	WALKER CREEK STATELINE RWA	1188
116	WALKER WATER ASSOCAITION	1140
639	WALKERVILLE WATER ASSOCIATION	516
298	WALNUT HILL WATER ASSOCIATION	266
309	WALNUT RIDGE WATERWORKS	5929
345	WARD WATERWORKS	8116
066	WARREN WATERWORKS	6875
574	WASHINGTON WATER AUTHORITY WWA	12850
232	WASHINGTON WATER SYSTEM	377
606	WATALULA WATER ASSOCIATION	1833
174	WATSON WATERWORKS	321
428	WEINER WATERWORKS	915

Thursday, June 25, 2009

Appendix J

Appendix J - No Violations For This Calendar Year

PWS ID	System Name	Retail population served
103	WESSON-NEWELL WATER ASSOC	583
878	WEST ASHLEY COUNTY WATER ASSN	671
577	WEST FORK WATERWORKS	2626
156	WEST MEMPHIS WATERWORKS	27780
682	WEST SALINE WATER USERS ASSN	1822
704	WESTERN GREENE COUNTY R W D	5012
400	WESTERN GROVE MUNICIPAL WATER	723
535	WHEATLEY WATERWORKS	840
804	WHELEN SPRINGS WATER DEPT	575
285	WHITE HALL WATERWORKS	4864
440	WICKES WATERWORKS	1195
538	WIDENER WATERWORKS	665
686	WILBURN WATER ASSOCIATION	687
562	WILDWOOD WATER ASSOCIATION	1282
529	WILLIFORD WATERWORKS	350
650	WILLISVILLE WATERWORKS	495
187	WILMAR WATERWORKS	886
021	WILMOT WATERWORKS	839
370	WILSON WATER SYSTEM	1072
321	WILTON WATERWORKS	500
188	WINCHESTER WATERWORKS	448
332	WINSLOW WATERWORKS	1368
700	WKMM RURAL WATER ASSOCIATION	424
471	WOODSON-HENSLEY WATER COMPANY	1164
695	WRIGHT-PASTORIA WATER ASSOC	1373
163	WYNNE WATERWORKS	8837
383	YARBRO WATERWORKS	388
PWS type: PWS type: N		
T1092	101 NORTH RESORT	50
T0024	ALPEN DORF MOTEL	50
935	AQUA CLEAR	30
1006	Aqua Flow Artesian Well	25
N0074	ASHLEY MINERAL SPRING	25
T0068	BAYOU RESORT	25
T1086	BEAR CREEK COUNTRY STORE	260
T0751	BEAVER RV PARK	30
N0080	BLACK BEAR SPRINGS	25
1001	Blue Heron Campground	25
T0350	BLUE WATER'S RESORT	52
T0081	BLUEBIRD LODGE	25

Thursday, June 25, 2009

Appendix J

Appendix J - No Violations For This Calendar Year

PWS ID	System Name	Retail population served
T0885	BOLL WEEVIL	300
T0087	BOY SCOUT CAMP ORR	300
924	BREAD AND THINGS	25
988	Brentwood Rest Area WVM	30
T0965	BUFFALO NATRV U4-08 OZARK CG	25
T0961	BUFFALO NATRV U4-24 KYLES CG	25
T0964	BUFFALO NATRV U4-59 ERBIE CG	25
T1022	BUFFALO NRV RUSH CAMPGROUND	25
T0098	BUFFALO NRVU2-01 BUFFALO POINT	25
T0963	BUFFALO NRVU4-02LOST VALLEYCG	25
T0096	BUFFALO NRVU4-06 UPPER PRUITT	25
T1082	BUFFALO POINT HWY 14	250
T0906	BUFFALO RV TYLER BEND CGU3-13	25
T0097	BUFFALO RV TYLER BEND MTU3-12	30
T0998	BULLFROG MARINA	25
1013	C. G. Roxane	25
T0120	CAMP KIA KIMA	500
973	CAMP WAR EAGLE	600
T0133	CASTAWAYS RESORT CAFE	25
T1095	CATALPA GENERAL STORE	25
T0431	CEDAR VALLEY INC	250
N0234	Celestial Beverage Company	25
938	CHRISTIAN LIFE CHURCH OF NW AR	50
T1103	CLOUD 9 RV PARK	25
N0190	COCA COLA BOTTLED WATER	25
N0087	COLGROVE SPRING WATER	25
1029	Culligan Harp's Ft Smith	30
1066	CULLIGAN HARPS124 FAYETTEVILLE	30
1065	CULLIGAN HARPS134 GREEN FOREST	30
1068	CULLIGAN NMKT5738 SPRINGDALE	30
1050	CULLIGAN NMKT5783 MAUMELLE	30
N0136	CULLIGAN OF NORTHWEST ARKANSAS	25
1049	CULLIGAN WMSC0007 SHERWOOD	30
1011	Culligan WMSC0133 Ashdown	30
977	CULLIGAN WMSC0358 ALMA	30
974	CULLIGAN WMSC336 SHERIDAN	30
1071	CULLIGAN WMSCO171 CAMDEN	30
N0166	CULLIGAN'S ASH FLAT WAL-MT160	30
N0139	CULLIGAN'S BENTON WAL-MART 85	30
N0156	CULLIGAN'S BENTONVILLE WAL-100	30

Thursday, June 25, 2009

Appendix J

Appendix J - No Violations For This Calendar Year

PWS ID	System Name	Retail population served
N0159	CULLIGAN'S BERRYVILLE WAL-MT76	30
N0150	CULLIGAN'S DARDANELLE HARPS	30
N0154	CULLIGAN'S ELDORADO WAL-M530	30
N0170	CULLIGAN'S FAYETTEVILLE WAL144	30
N0153	CULLIGAN'S FORREST CITY WAL-91	30
N0192	CULLIGAN'S FT SMITH WALM125	30
N0165	CULLIGAN'S FT SMITH WAL-MA141	30
N0202	CULLIGAN'S HARP'S 119	30
N0176	CULLIGAN'S HEBER SPRING WAL281	30
N0178	CULLIGAN'S HOLIDAY ISLAND SUNF	30
N0216	CULLIGAN'S HOT SPRNGS WAL-MA52	30
N0162	CULLIGAN'S HUNTSVILLE HARPS	30
N0175	CULLIGAN'S JONESBORO WAL-M128	30
N0160	CULLIGAN'S JONESBORO WAL-M145	30
N0197	CULLIGAN'S NEIGHBORHOOD MARKET	30
N0201	CULLIGAN'S NEIGHBORHOOD MK2745	30
N0229	CULLIGAN'S NEIGHBORHOOD MK3479	30
N0223	CULLIGAN'S NMKT2742 SPRINGDALE	30
N0225	CULLIGAN'S NMKT2744 FT SMITH	30
N0161	CULLIGAN'S PARAGOULD WAL-MAR36	30
N0164	CULLIGAN'S POCAHONTAS WAL-M71	30
N0155	CULLIGAN'S SILOAM SPGS PC 356	30
N0168	CULLIGAN'S SPRINGDALE WAL-MA54	240
N0142	CULLIGAN'S STUTTGART WAL-M102	30
N0211	CULLIGAN'S VB WMSC 16	30
N0152	CULLIGAN'S W HELENA WAL-MA714	30
N0151	CULLIGAN'S W MEMPHIS WAL-MA70	30
N0191	CULLIGAN'S WALM124 LITTLE ROCK	30
965	CULLIGAN'S WMS0058 RUSSELLVILLE	30
N0218	CULLIGAN'S WMSC0004 SILOAM SP	30
909	CULLIGAN'S WMSC0033 NASHVILLE	30
N0233	CULLIGAN'S WMSC0066 CLARKSVILL	30
911	CULLIGAN'S WMSC0068 WYNNE	30
907	CULLIGAN'S WMSC0083 MAGNOLIA	30
N0219	CULLIGAN'S WMSC0119 BATESVILLE	30
939	CULLIGAN'S WMSC0167 CROSSETT	30
933	CULLIGAN'S WMSC0229 TRUMANN	30
N0224	CULLIGAN'S WMSC0261 HOT SPRING	30
921	CULLIGAN'S WMSC0279 DEQUEEN	30
930	CULLIGAN'S WMSC0380 WALDRON	30

Thursday, June 25, 2009

Appendix J

Appendix J - No Violations For This Calendar Year

PWS ID	System Name	Retail population served
N0231	CULLIGAN'S WMSC0468 TEXARKANA	30
N0221	CULLIGAN'S WMSC1065 HOPE	30
N0222	CULLIGAN'S WMSC3230 BRYANT	30
918	CULLIGAN'S WMSC3331 PINE BLUFF	30
946	CULLIGAN'S WMSC5260 ROGERS	30
934	CULLIGAN'S WMSC5433 HSV	30
1041	CUZN OZARK FOODS	30
T0195	DOGWOOD LODGE	25
T0207	EDGEWATER RESORT LODGE	50
T1107	EUREKA SPRINGS SPORTS FIELD	30
T0116	FERNCLIFF CAMP CONFER CENTER	162
T0214	FERNDALE GROCERY	25
T0215	FISH FIDDLE RESORT	30
942	FRED BERRY CONSERVATION ED CTR	25
T0227	FRED'S COUNTRY COOKIN	100
T1081	FRED'S TOTAL STATION	30
T0233	GENOA GROCERY 46	100
1064	GLACIER ALCO233 RUSSELLVILLE	30
1058	GLACIER CRANFORD'S HSV	30
1059	GLACIER CRANFORDS LONSDALE	30
1060	GLACIER CRANFORD'S REDFIELD	30
1057	GLACIER CRANFORD'S WHITE HALL	30
1045	GLACIER FOOD GIANT 19 FC	30
1055	GLACIER FOOD GIANT 3445 HELEA	30
1046	GLACIER FOOD GIANT 37 MAR	30
1053	GLACIER HF1508 CLINTON	30
1025	Glacier HF6223 LR	30
1044	GLACIER HF6261 HS	30
1072	GLACIER LAKESIDE MKT HS	30
1051	GLACIER SAVE A LOT40SS	30
N0239	GLACIER WATER ALB TEXARK 4318	30
914	GLACIER WATER BG ASHDOWN 4365	30
N0245	GLACIER WATER BG CAMDEN 2239	30
N0244	GLACIER WATER BG CROSSETT 0494	30
N0242	GLACIER WATER BG ELDORADO 2195	30
N0243	GLACIER WATER BG MAGNOLIA 2371	30
915	GLACIER WATER BG PB 5155	30
917	GLACIER WATER BG PB 5613	30
941	GLACIER WATER SM STAMPS 5524	30
T1101	GRASSY KNOB SUBORDINATE SD	25

Thursday, June 25, 2009

Appendix J

Appendix J - No Violations For This Calendar Year

PWS ID	System Name	Retail population served
T0486	HIDE A WAY CAMPGROUND	367
1048	Holly St WVM SS	30
T1052	HORIZON RESTAURANT	25
T0915	HOT SPR NAT PK HAPPY HOLLOW SP	25
T0916	HOT SPR NAT PK WHITTINGTON SPR	25
T0259	HOT SPRINGS NATIONAL PARK	25
T0261	HWY 27 FISHING VILLAGE	25
T0714	HWY 27 REC AREA	25
T0291	KAY'S GROCERY GAS INC	25
T0297	KETTLE CAMPGROUND	30
T0308	KOA CAMPGROUND STORE	40
T0312	LAKE LEATHERWOOD CAMPGROUND	25
993	Lake Shore Cabins	25
T0928	LIGHTHOUSE POINT RESORT	50
T0330	LITTLE FIR LANDING	25
T1090	LOST BRIDGE MARINA	30
T0829	LOST BRIDGE MOTEL	25
T0338	LOWERY'S CAMPGROUND	25
T0341	MANY ISLAND CAMP	200
N0068	MARCELLA SPRINGS	25
T0373	MOOSE CLUB 1953	220
N0094	MOUNTAIN PURE LLC	30
N0073	MT VALLEY SPRING CO	25
T1068	NORFORK LAKE ESTATES-MOHR ADD	30
957	NORFORK MARINA	0
1067	NWS INC WHLOE FOODS LR	30
1005	Oak Hill Lodge SGT	25
T0391	OARK GEN STORE	50
T1079	ON TARGET FAMILY SPORTS CENTER	30
T1016	OUTDOOR RESORTS OF THE OZARKS	500
T0406	OZARK REGULAR BAPTIST CAMP	25
1018	Parthenon Church of God	25
T0418	PEAL'S RESORT	60
T0439	PONCA BIBLE CAMP	70
T0931	PORT ORLEANS RESTAURANT	50
T1037	RIVERSIDE RESORT	250
T0467	RIVERSIDE RESORT	25
T0468	RIVERVIEW COUNTRY STORE	30
T0472	ROCKING CHAIR RANCH	30
T1085	RUSSELL'S RV PARK	30

Thursday, June 25, 2009

Appendix J

Appendix J - No Violations For This Calendar Year

PWS ID	System Name	Retail population served
928	SADDLER FALLS RESORT	25
925	SHADY OAK RV PARK	25
T1067	SHEPHERD OF THE OZARKS	30
T0294	SHEPHERDS INN RETREAT CENTER	50
T1094	SHIRLEY'S OUTBACK	25
T0513	SPRING RIVER OAKS CAMP	25
T1064	STATUE ROAD INN	30
T0322	THE LANGLEY STORE	25
T0399	THE OUTPOST	50
T0576	USCOE BMW08 ASHLEY CREEK	25
T0588	USCOE BSWP109 TUCKER HOLLOW	40
T0589	USCOE BSWP110 TUCKER HOLLOW	25
T0590	USCOE BSWP116 OAKLAND	25
T0592	USCOE BSWP129 BUCK CREEK	25
T0974	USCOE BWP POWER HOUSE	25
T0601	USCOE BWP17 LOST BRIDGE	25
T0604	USCOE BWP24 DAM SITE	25
T0605	USCOE BWP25 DAM SITE	25
T0892	USCOE BWP29 STARKEY PARK	25
T0609	USCOE BWP33 LOST BRIDGE	25
T0894	USCOE BWP39 DAM SITE - PARKER	25
T0612	USCOE DG ALPINE RIDGE	25
T0619	USCOE DG LENOX MARCUS	25
T0620	USCOE DG LOWER LAKE	25
T0622	USCOE DG OZAN POINT	25
T0680	USCOE MIP2 RESIDENT OFFICE	25
T0682	USCOE MIP5 COTTONSHED	25
T1035	USCOE NF PANTHER BAY	160
T0689	USCOE NFWP12 ROBINSON POINT	200
T0691	USCOE NFWP15 PANTHER BAY	50
T0692	USCOE NFWP18 HENDERSON	80
T0889	USCOE NFWP21A WOODS POINT	25
T0695	USCOE NFWP25 BIDWELL POINT	200
T0696	USCOE NFWP29 GAMALIEL	125
T0699	USCOE NFWP5 GEORGES COVE	25
T0724	USCOE OC - AVERY TRAIL	25
T0709	USCOE OC - BRADY MTN	200
T0718	USCOE OC - LITTLE FIR	100
T1099	USCOE PB JARDIS POINT PARK	25
T1013	USCOE PBW WILBUR MILLS PARK	25

Thursday, June 25, 2009

Appendix J

Appendix J - No Violations For This Calendar Year

PWS ID	System Name	Retail population served
T0763	USFS ALBERT PIKE REC AREA	100
T0770	USFS BLANCHARD	25
T0778	USFS COVE LAKE CAMP A	25
T0786	USFS GUNNER POOL	25
T0788	USFS HORSEHEAD BATHHOUSE	25
T0797	USFS LITTLE PINES REC AREA	25
T0806	USFS REDDING	30
T0808	USFS RICHLAND CREEK	25
T0810	USFS SHADY LAKE REC AREA 16661	25
T0814	USFS SHORES LAKE	25
T0821	USFS WHITE ROCK	35
1062	VALLEY MERCANTILE	25
970	VENTRIS TRAILS END RESORT	50
T0832	WAGON WHEEL RESTAURANT	150
T0825	WALDRON'S VALLEY CAFE	50
T0835	WANDERLUST RV PARK	25
T1106	WATER WAGON	25
N0137	WATERWELL EXPRESS - FARMINGTON	30
N0084	WILDERNESS VALLEY SPRING	25
PWS type:PWS type: P		
N0180	4-H CENTER	30
N0103	AHTD HARRISON 9 HEADQUARTERS	90
N0129	AHTD MARION COUNTY	285
N0022	ALBEMARLE CORPORATION SOUTH	550
N0021	ALBEMARLE CORPORATION WEST	150
N0237	CHRISTIAN MINISTRY ACADEMY	400
N0181	CIBA SPECIALTY CHEMICAL	160
N0052	CLEARWATER PAPER CORPORATION	339
N0032	EVERGREEN PACKAGING PINE BLUFF MILL	1150
N0025	GENOA CENTRAL SCHOOL	924
N0028	GEORGIA PACIFIC PAPER MILL	1400
N0214	GEORGIA PACIFIC WOOD PRODUCTS LLC	100
N0106	Great Lakes Chemical West	25
T1065	GREENWICH CENTER	30
N0037	KINGSTON SCHOOL	250
932	MOUNTAIN DEVELOPMENT	100
N0046	NAT CTR FOR TOXOLOGICAL RES	220
N0048	OARK SCHOOLS	200
N0189	R V A F TEXARKANA	120
N0057	REMINGTON ARMS COMPANY	860

Thursday, June 25, 2009

Appendix J

Appendix J - No Violations For This Calendar Year

PWS ID	System Name	Retail population served
N0088	THE GREAT PASSION PLAY	50
N0126	THE LORD'S RANCH	95
1019	TOWERING OAKS BAPTIST CHURCH	25
N0069	VISKASE CORPORATION	236
N0228	WILSON GUN SHOP INC	50

Appendix K - Enforcement Actions

PWS type: C

PWS ID2	System Name	Enforcement Action	Date Issued	Rule Violated
303	ALICIA WATER SYSTEM	Warning of Administrative Order	6/25/2008	TCR/MCL
863	ALL SEASONS MHP	Proposed Penalty	12/22/2008	SWTR/TCR
088	AMITY WATERWORKS	Warning of Administrative Order	2/20/2008	SWTR/DBPR
519	BEN LOMOND WATERWORKS	Administrative Order	5/16/2008	TCR
543	BEULAH GROVE WATER	Penalty Suspended - Bilateral Compliance Agreement	8/22/2008	L
326	BOONEVILLE WATERWORKS	Warning of Administrative Order	12/22/2008	DBPR
653	BRANCH WATER WORKS	Warning of Administrative Order	2/20/2008	TCR/DBPR
404	CAMDEN WATERWORKS	Warning of Administrative Order	11/26/2008	DBPR
261	CAMPBELL STATION WATERWORKS	Warning of Administrative Order	5/16/2008	L
130	CASH WATERWORKS	Warning of Administrative Order	10/31/2008	TCR
200	CHARLESTON WATERWORKS	Penalty Suspended - Bilateral Compliance Agreement	6/25/2008	TCR/DBPR
789	CHERRY HILL PUBLIC FACILITY BD	Warning of Administrative Order	5/16/2008	DBPR
789	CHERRY HILL PUBLIC FACILITY BD	Administrative Order	12/29/2008	DBPR/TCR
603	DANVILLE WATERWORKS	Warning of Administrative Order	4/18/2008	TCR/DBPR/SWTR
143	DYER WATERWORKS	Warning of Administrative Order	10/17/2008	DBPR
458	EAST PRAIRIE CO WATER ASSOC	Warning of Administrative Order	10/31/2008	TCR
550	EL DORADO WATERWORKS	Warning of Administrative Order	1/31/2008	TCR/DBPR
544	FAIRCREST WATER ASSOCIATION	Warning of Administrative Order	2/20/2008	DBPR
016	FOUNTAIN HILL WATERWORKS	Proposed Penalty	1/16/2008	TCR/DBPR
016	FOUNTAIN HILL WATERWORKS	Proposed Penalty	7/10/2008	TCR/DBPR

Thursday, June 25, 2009

Appendix K

Appendix K - Enforcement Actions

436	HATFIELD WATERWORKS	Warning of Administrative Order	2/20/2008	DBPR
427	HEAFER-BLACK OAK WATER ASSOC	Warning of Administrative Order	1/31/2008	TCR/SREA
885	HIGHFILL WATER DEPARTMENT	Warning of Administrative Order	2/20/2008	DBPR
885	HIGHFILL WATER DEPARTMENT	Penalty Suspended - Bilateral Compliance Agreement	7/17/2008	DBPR
884	HOSANNA HEIGHTS WATER	Warning of Administrative Order	5/16/2008	TCR
010	HUMPHREY WATERWORKS	Warning of Administrative Order	10/31/2008	TCR
552	JUNCTION CITY WATERWORKS	Warning of Administrative Order	12/22/2008	TCR
780	LAKE LUCERNE ESTATES	Warning of Administrative Order	2/20/2008	L&C/TCR
327	MAGAZINE WATERWORKS	Warning of Administrative Order	11/26/2008	DBPR
246	MAGNESS WATER ASSOCIATION	Warning of Administrative Order	7/10/2008	L
246	MAGNESS WATER ASSOCIATION	Administrative Order	9/26/2008	L
382	MARIE WATER SYSTEM	Warning of Administrative Order	1/31/2008	TCR
705	MC NEIL RURAL WATER ASSOC	Warning of Administrative Order	1/31/2008	TCR
951	MONTGOMERY CO REGIONAL PWA	Warning of Administrative Order	10/17/2008	DBPR/SWTR
020	MONTROSE WATERWORKS	Administrative Order	4/18/2008	TCR/MCL
864	MT MORIAH WATER DISTRICT	Warning of Administrative Order	3/31/2008	TCR
864	MT MORIAH WATER DISTRICT	Warning of Administrative Order	4/10/2008	L
703	MT ZION WATER ASSOCIATION	Warning of Administrative Order	4/10/2008	L
703	MT ZION WATER ASSOCIATION	Administrative Order	7/10/2008	L
136	MULBERRY WATERWORKS	Warning of Administrative Order	2/20/2008	TCR/SW/DB
136	MULBERRY WATERWORKS	Administrative Order	12/22/2008	DBPR/SWTR

Appendix K - Enforcement Actions

425	MURFREESBORO WATERWORKS	Warning of Administrative Order	2/20/2008	DBPR
867	N GARLAND CO REG WATER DIST	Warning of Administrative Order	11/26/2008	DBPR
805	NASHVILLE RURAL WATER ASSOC	Administrative Order	4/18/2008	DBPR/TCR
244	NASHVILLE WATERWORKS	Warning of Administrative Order	12/29/2008	DBPR
557	NEW LONDON WATER ASSOCIATION	Administrative Order	7/10/2008	DBPR
557	NEW LONDON WATER ASSOCIATION	Administrative Order	10/17/2008	DBPR
391	NORMAN WATERWORKS	Penalty Suspended - Bilateral Compliance Agreement	10/23/2008	SWTR
826	NORTH PIKE CO RURAL WATER ASSN	Warning of Administrative Order	2/20/2008	DBPR
175	NORTHERN OHIO WATER ASSOC	Warning of Administrative Order	1/31/2008	TCR/SREA
616	ODEN- PENCIL BLUFF WATER ASSN.	Penalty Suspended - Bilateral Compliance Agreement	1/3/2008	L
616	ODEN- PENCIL BLUFF WATER ASSN.	Warning of Administrative Order	10/17/2008	TCR/DBPR
580	PANGBURN WATERWORKS	Penalty Suspended - Bilateral Compliance Agreement	3/12/2008	DBPR
883	PARON-OWENSVILLE WATER AUTH	Warning of Administrative Order	2/20/2008	DBPR
818	PIKE CITY WATER ASSN	Administrative Order	4/18/2008	TCR/DBPR
605	PLAINVIEW WATER DEPARTMENT	Warning of Administrative Order	5/16/2008	TCR/DBPR
018	PORTLAND WATERWORKS	Warning of Administrative Order	7/10/2008	DBPR
018	PORTLAND WATERWORKS	Warning of Administrative Order	10/17/2008	DBPR
394	PRESCOTT WATERWORKS	Administrative Order	5/27/2008	TCR/DBPR
329	RATCLIFF WATERWORKS	Warning of Administrative Order	7/10/2008	TCR/DBPR
329	RATCLIFF WATERWORKS	Administrative Order	12/22/2008	TCR/DBPR
985	RED BUD MOBILE HOME PARK	Warning of Administrative Order	12/22/2008	SWTR/TCR

Thursday, June 25, 2009

Appendix K

Appendix K - Enforcement Actions

868	SEVIER CO WATER ASSOCIATION	Warning of Administrative Order	2/20/2008	DBPR
851	SOUTH LOGAN COUNTY WATER	Warning of Administrative Order	2/20/2008	TCR/DBPR
254	SOUTHSIDE PUB WATER AUTHORITY	Warning of Administrative Order	2/20/2008	TCR/DBPR
166	SPARKMAN WATERWORKS	Warning of Administrative Order	3/31/2008	DBPR
334	SUBIACO ACADEMY WATERWORKS	Penalty Suspended - Bilateral Compliance Agreement	12/31/2008	DBPR/SWTR
355	SUMMIT WATERWORKS	Warning of Administrative Order	10/17/2008	TCR
360	TEXARKANA WATER UTILITIES	Warning of Administrative Order	10/17/2008	DBPR
727	VAN BUREN COUNTY W U A	Warning of Administrative Order	4/18/2008	DBPR
283	WABBASEKA WATERWORKS	Penalty Suspended - Bilateral Compliance Agreement	7/15/2008	L
283	WABBASEKA WATERWORKS	Warning of Administrative Order	10/17/2008	TCR
498	WALDRON WATERWORKS	Warning of Administrative Order	10/17/2008	DBPR
116	WALKER WATER ASSOCAITION	Proposed Penalty	2/15/2008	L
196	WOOSTER WATERWORKS	Warning of Administrative Order	2/20/2008	DBPR
410	WYE MOUNTAIN WATER ASSOCIATION	Warning of Administrative Order	11/26/2008	DBPR

PWS type: N

PWS ID2	System Name	Enforcement Action	Date Issued	Rule Violated
T0323	101 Great American Diner	Warning of Administrative Order	2/20/2008	TCR
T0323	101 Great American Diner	Administrative Order	5/16/2008	TCR/MCL
T1054	62 Food Mart	Warning of Administrative Order	2/20/2008	TCR
T1054	62 Food Mart	Administrative Order	11/26/2008	TCR
960	ANTIOCH CHURCH	Warning of Administrative Order	2/20/2008	TCR
960	ANTIOCH CHURCH	Administrative Order	12/22/2008	TCR

Thursday, June 25, 2009

Appendix K

Appendix K - Enforcement Actions

T0091	BROOKHILL RANCH	Warning of Administrative Order	10/31/2008	TCR
T1003	CEDAR FALLS MOTEL	Warning of Administrative Order	11/26/2008	TCR
T0178	CRYSTAL MTN MEX RESTAURANT	Warning of Administrative Order	12/22/2008	TCR
N0186	CULLIGAN WATER CONDITIONING	Warning of Administrative Order	10/17/2008	TCR
T0204	ECHO POINT RESORT	Administrative Order	3/12/2008	DBPR
T0204	ECHO POINT RESORT	Proposed Penalty	7/10/2008	TCR
T1105	EUREKA MUSIC PARK	Administrative Order	4/8/2008	TCR
972	GENERAL WATER CONDITIONING	Administrative Order	3/12/2008	TCR
T1080	JOHNSON'S MR K FOODS	Administrative Order	3/12/2008	TCR
T1080	JOHNSON'S MR K FOODS	Proposed Penalty	7/10/2008	TCR
T0494	KRESS CATERING	Warning of Administrative Order	2/20/2008	TCR
T0391	OARK GEN STORE	Warning of Administrative Order	3/31/2008	TCR
T0411	PACKSADDLE RESTAURANT	Warning of Administrative Order	5/16/2008	TCR
T0413	PARKS SENIOR CENTER	Warning of Administrative Order	5/16/2008	TCR
T0414	PARKWAY TRAVEL PARK	Warning of Administrative Order	2/20/2008	TCR
958	SOUTHFORK RESORT	Administrative Order	5/27/2008	TCR
T0524	SUNRISE POINT RESORT	Warning of Administrative Order	2/20/2008	SWTR/TCR
945	SUPERLIFT ORV PARK	Warning of Administrative Order	2/20/2008	TCR

PWS type: P

PWS ID2	System Name	Enforcement Action	Date Issued	Rule Violated
T1110	ARK STATE PARK MT MAGAZINE	Warning of Administrative Order	9/26/2008	DBPR

Thursday, June 25, 2009

Appendix K